



UNCLASSIFIED//~~FOUO~~



ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

01 January 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



AGENDA

- ◆ **Overview** **Captain**
- ◆ **Fire & Electrical Incidents** **Captain**
- ◆ **Inspection Summary** **Captain** (b)(3)(b)(6)
- ◆ **CCF Update** **Captain**
- ◆ **ISI Status** **Major** (b)(3), (b)(6)
- ◆ **Fire Chief's Report** **Chief** (b)(3), (b)(6)
- ◆ **Awareness Campaign** **LTC** (b)(3), (b)(6)

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



OVERVIEW


- ***3 bases completed for initial inspections of Life, health, and Safety. 18 of 35 now complete.***
- ***Contractor Camp census underway***
- ***KBR major electrical projects on Non-enduring bases awaiting Mayor review for cancellation***
- ***IHEC Un-interrupted Power Supplies need replacing***

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

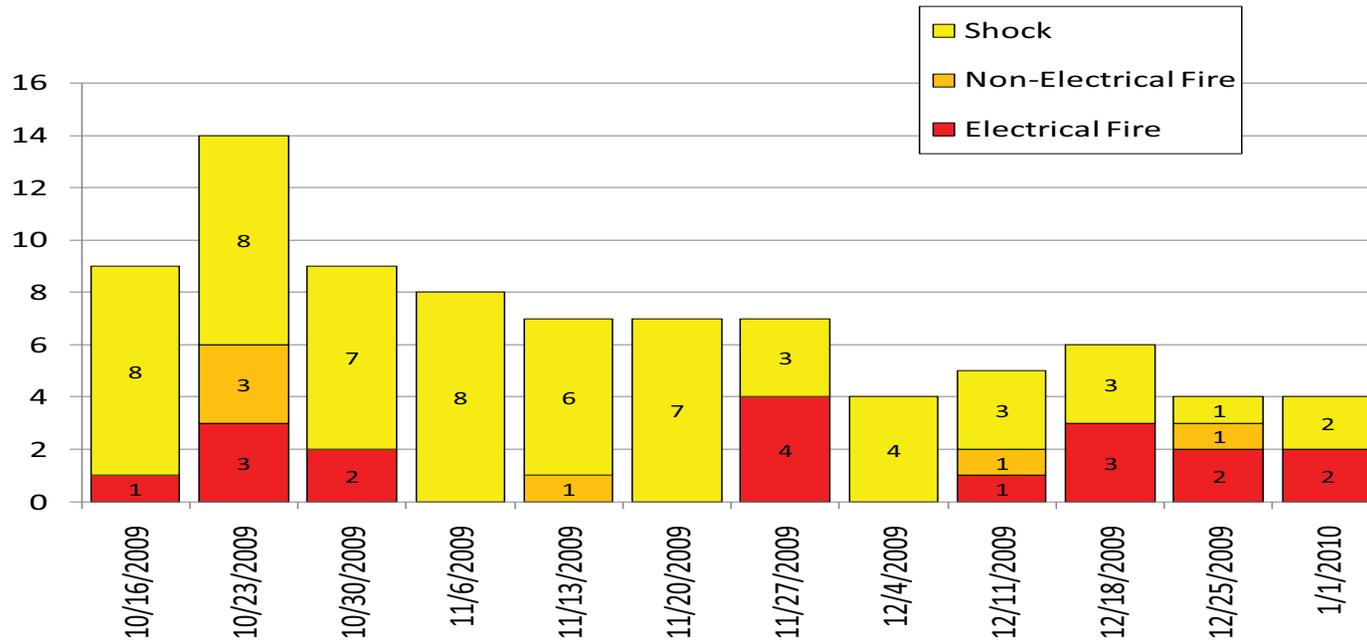

Weekly Comparison

	Week of 12/25/2009	12-Wk Avg
Electrical Fire	2 ↑	1.50
Non-Electrical Fire	1 ↑	0.50
Total Fires	3 ↑	2.00
Shock	1 ↓	5.00

Below 12-wk Average ↓
 Above 12-wk Average ↑

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INSPECTION SUMMARY

INITIAL INSPECTION	TOTAL INSPECTIONS	PASSED	FAIL FLASH	FAIL PRIORITY	Facilities with Un-Mitigated Flashes	PASS RATE	LHS PASS RATE
INSPECTION	106,534	61,613	25,638	19,283	2,050	57.83%	75.93%
LAST WEEK (Difference)	1,698	1,107	385	206	51	65.19%	77.33%
RE-INSPECTION	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE	Flashed Facilities Ready for Re-Inspection
RE-INSPECTIONS	30,535	25,479	1,793	3,263	83.44%	94.13%	
LAST WEEK (Difference)	642	503	59	80	78.35%	90.81%	


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



UN-MITIGATED FLASHES

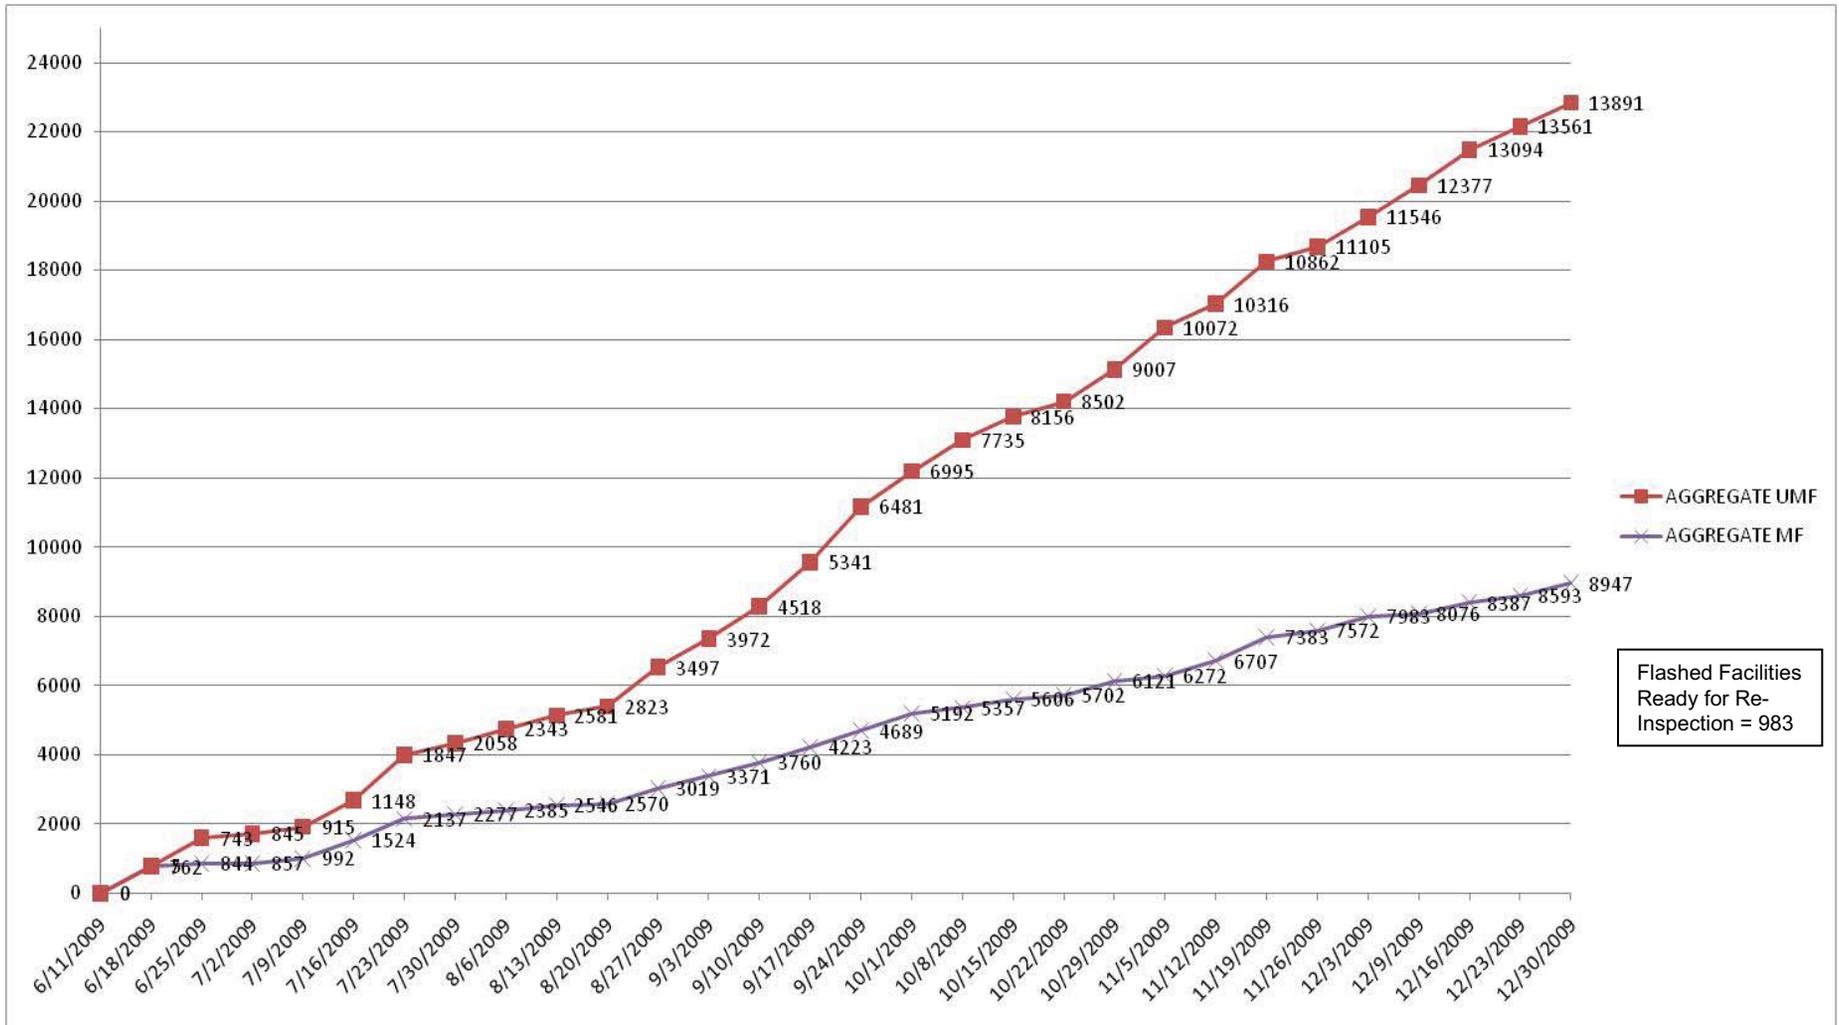


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TOTAL INSPECTION RATES

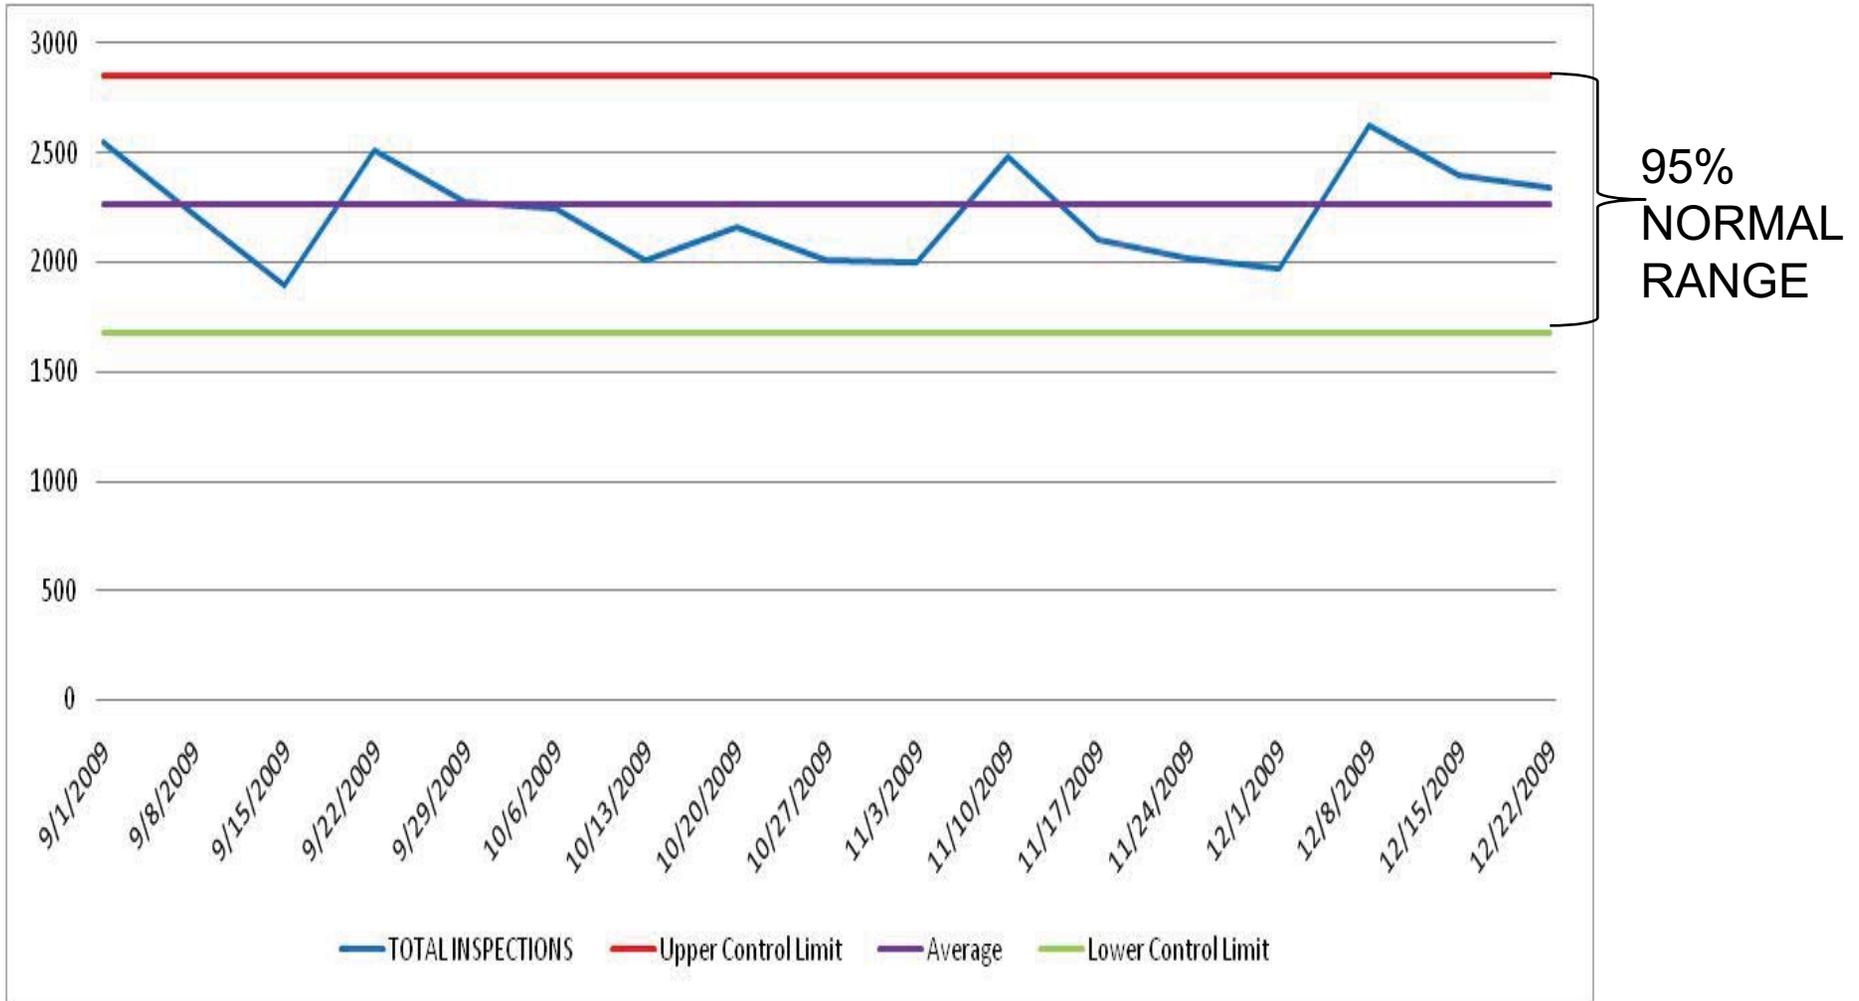


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

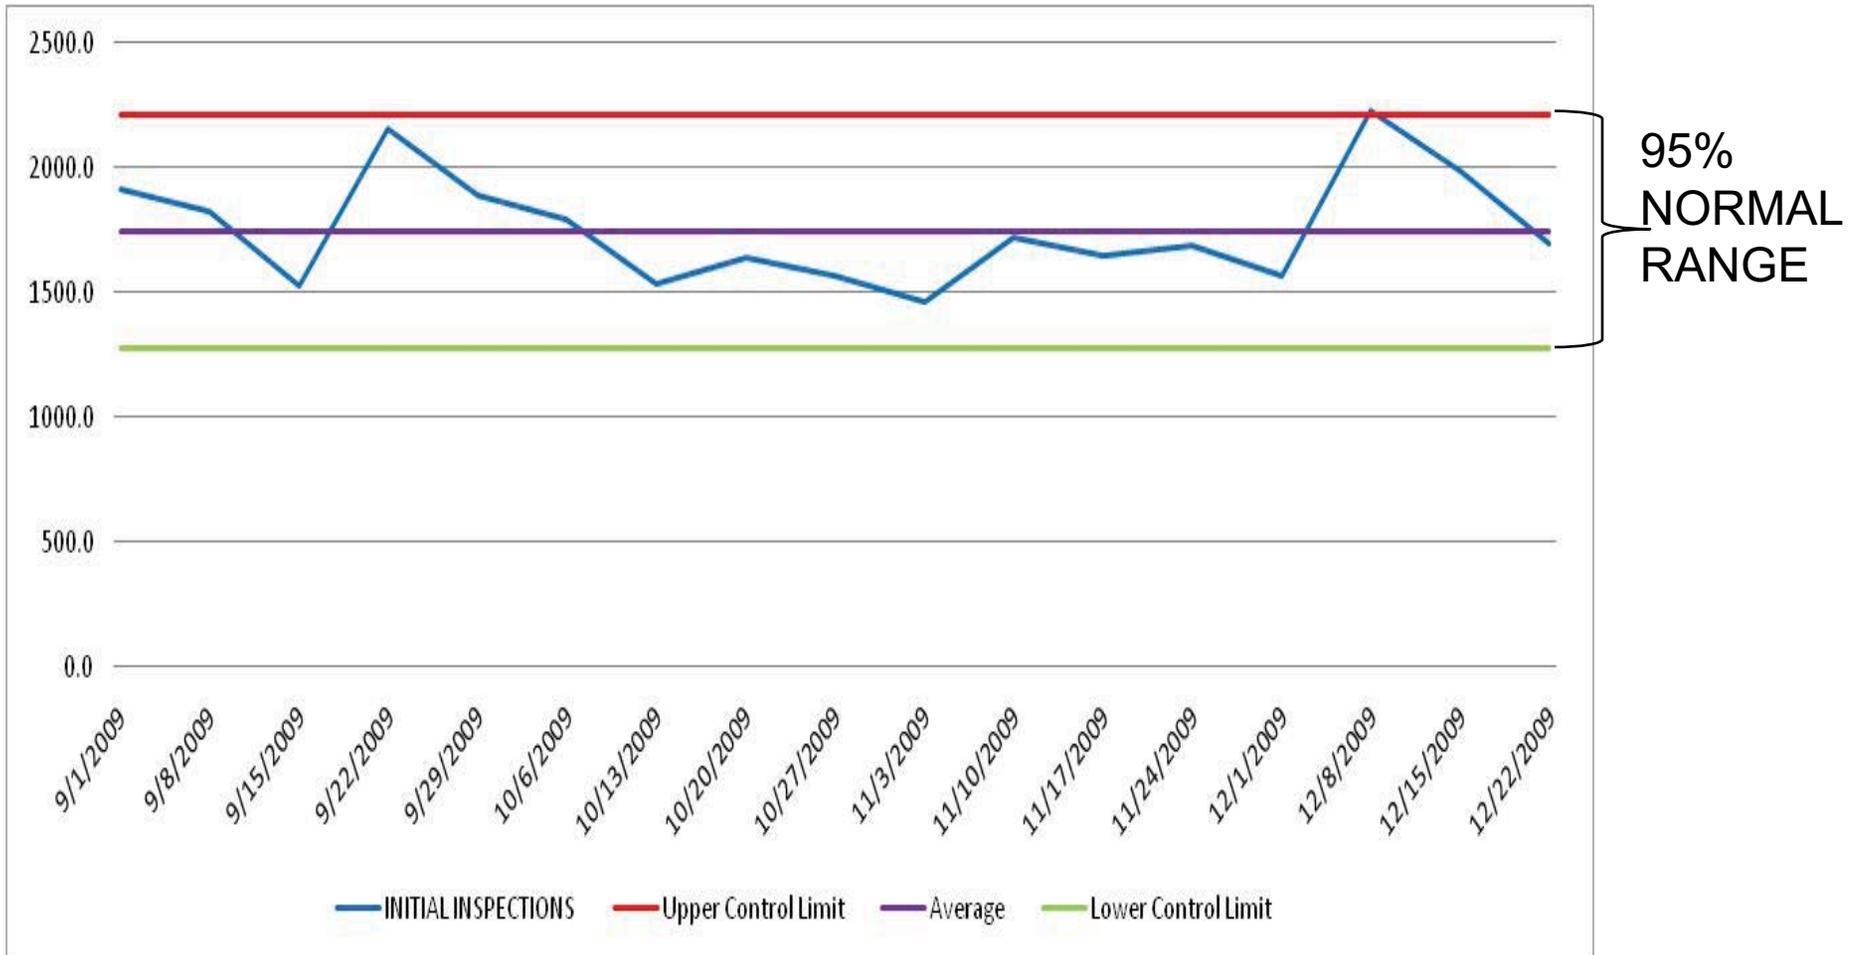


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

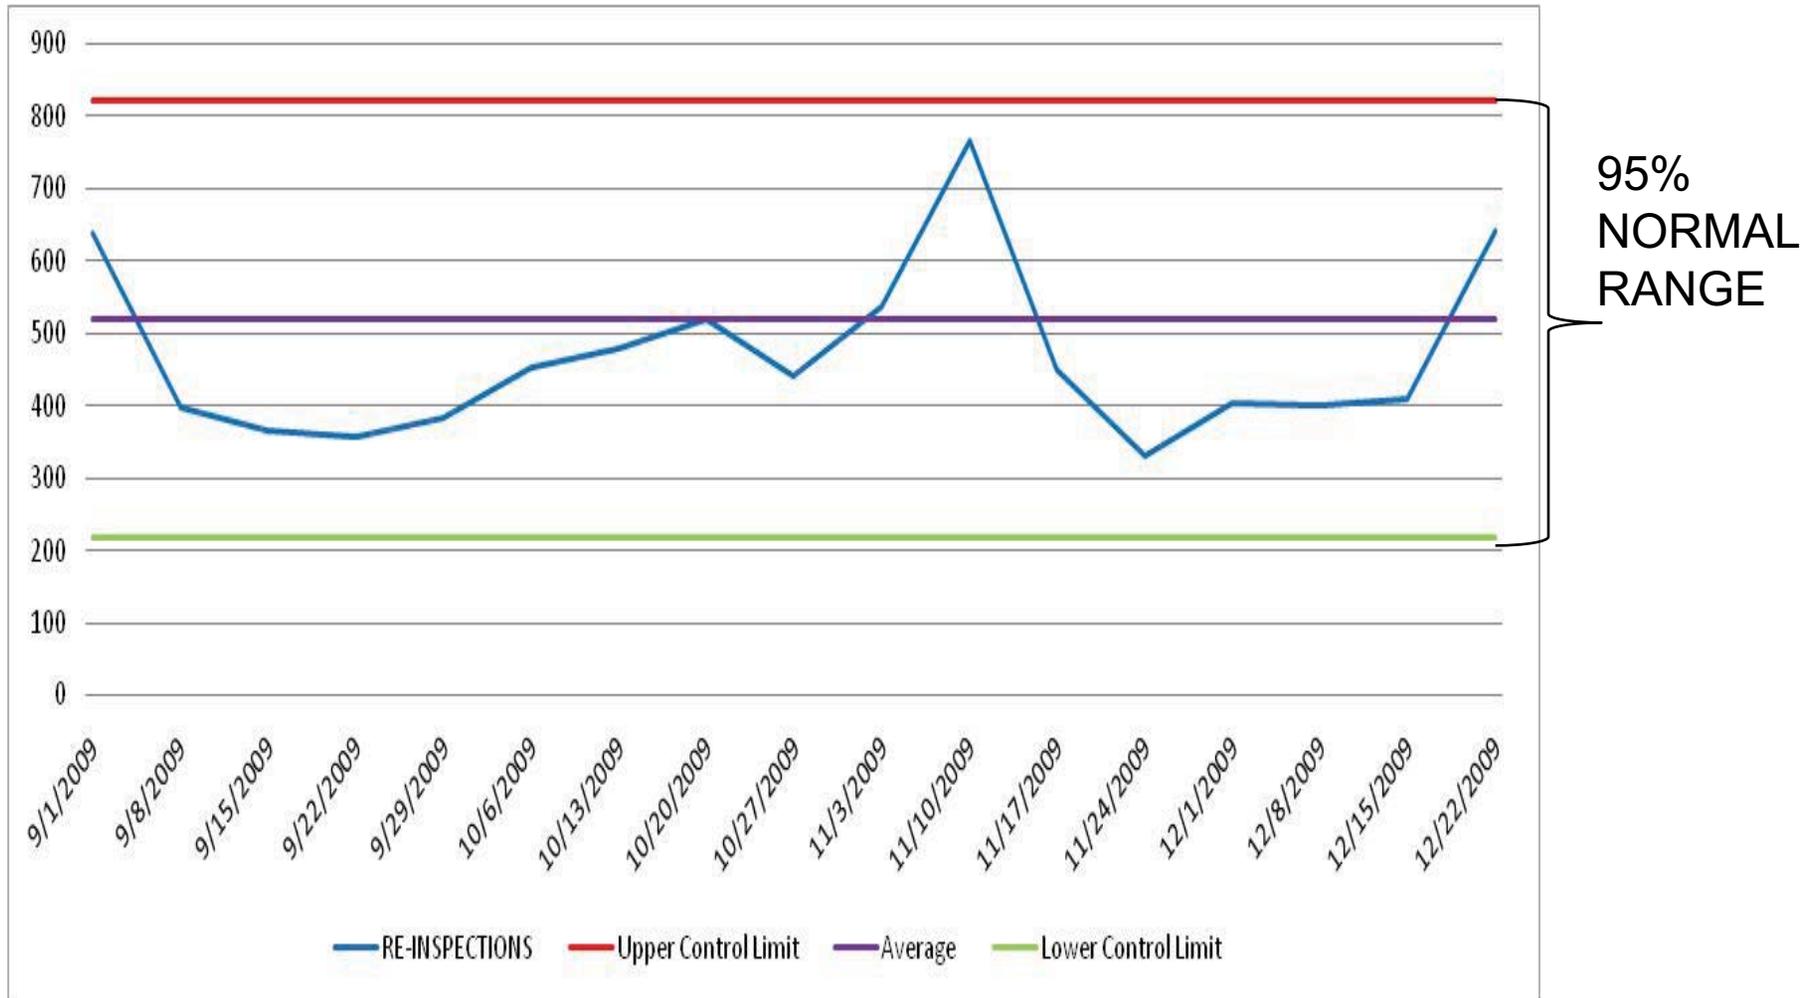

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments

	Total Camps	Assessed by TF SAFE	SAT	UNSAT	Pass %	Re-assessed	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	110	54	27	27	50%	0	0	0	n/a	9
All Others	243	83	16	67	19%	6	6	0	100%	17
Total	353	137	43	94	31%	6	6	0	100%	26

- Camps Assessed This Week: 21
 - Scores: 11 SAT 10 UNSAT
- Camps remaining to be assessed: 190
- Camps added over last week: 3 (discovered during camp census)
- Camps administratively added over last week: 26 (previously inspected added back on)
- Camps administratively removed: 12 (results of census – missing or closed)

UNCLASSIFIED//~~FOUO~~



~~UNCLASSIFIED/FOUO~~



Inglett & Stubbs Repair Progress

	Total Locations	Complete Locations	Remaining Facilities	Facilities Complete	% Complete	Projected Completion Date	Un-Mitigated Flash (UMF) Deficiencies Repaired	Number of Repair Teams
MND-B/IZ	60	52	8	1210	87%	1/7/2010	35	2
MND-S	34	29	5	997	85%	1/9/2010	0	3
MND-N	65	51	14	1046	78%	2/26/2010	0	5
MND-W	35	35	0	1016	100%	COMPLETE	0	0
TOTALS	194	167	27	4269	86%	FEB 2010	35	10

MND-B/IZ	LOCATION	STATUS
TEAM 3	VBC	Performing UMF repairs-one team member R&R return 01/06/2010
TEAM 8	VBC	Inspected 4xUPCs at IHEC-returned 12/31/09, refitting for COL Suj
MND-S		
TEAM 1	Basra	Prepping to move to Hunter
TEAM 7	Umm Sa'ah	Arrived Umm Sa'ah to make assessments and repairs
TEAM 9	Umm Sa'ah	Arrived Umm Sa'ah to make assessments and repairs
MND-N		
TEAM 2	Balad	Working on reports, preparation for return to KMTB, working Non-O&M.
TEAM 4	Balad	Assisting Team 2 at KMTB
TEAM 5	Marez	Marez Air Base making UMF repairs/Refitting for next mission
TEAM 6	COB Speicher	Performing UMF repairs
TEAM 10	COB Speicher	Performing UMF repairs, one team member supporting Team 5

~~UNCLASSIFIED/FOUO~~



UNCLASSIFIED//~~FOUO~~



FIRE CHIEF'S REPORT

ORI Pass -	1 st	2 nd	3 rd
<u>SYKES –</u>	<u>88.3- 86.2%- 93.7.0%</u>		
Fire Fighting Drills-	95.0%	90.5%	97.5%
Administrative -	82.6%	82.8%	90.6%


➤ ORI Team has moved to Q West this week.



Live Fire Drill



ARFF Egress Drill

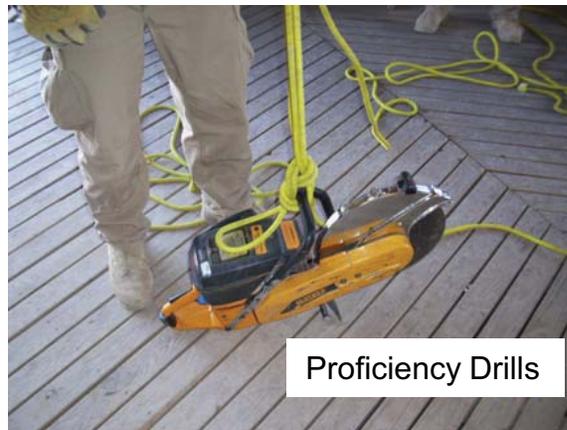

Proficiency Drills



Structural Drill

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 12/31
Awareness	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	MNC-I PAO conduct interviews with TF SAFE Chief, Deputy Chief, Master Electrician, Fire Chief, and SGM. Rotate TF SAFE personnel to AFN Freedom Radio on Thursdays.	MNC-I Safety	
	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	MNC-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets- Not released yet- investigating	Submitted as Needed- New screensavers in production	MNC-I Safety	
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	MNC-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Victory Mayor's cell and AAFES PX system- in place Country wide	110/220 voltage compatibility signage and Safety video on TVs	MNC-I Safety	

UNCLASSIFIED//~~FOUO~~