



UNCLASSIFIED//~~FOUO~~



ONE TEAM

ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

2 April 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



AGENDA

- ◆ **Overview** **Capt**
- ◆ **Fire & Electrical Incidents** **Capt** (b)(3)(b)(6)
- ◆ **Inspection Summary** **Capt**
- ◆ **CCF Update** **MAJ**
- ◆ **ISI Status** **MAJ** (b)(3), (b)(6)
- ◆ **Fire Chief's Report** **Chief** (b)(3), (b)(6)
- ◆ **Awareness Campaign** **Mr.** (b)(6)

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



OVERVIEW


- **Welcome aboard: SFC (b)(3)(b)(6) – new TF SAFE NCOIC**
- **Welcome aboard: Mr (b)(6) USACE Electrician – assigned to Data Inte**
- **MAJ (b)(3)(b)(6) – Union III East LSA progress site visit**
- **Inspection of Tallil A/C Tower and Perimeter Fence projects in progress**
- **Due to heavy demand – Additional Electrical Awareness course scheduled for 19/20 Apr – 2 courses now scheduled for April**

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

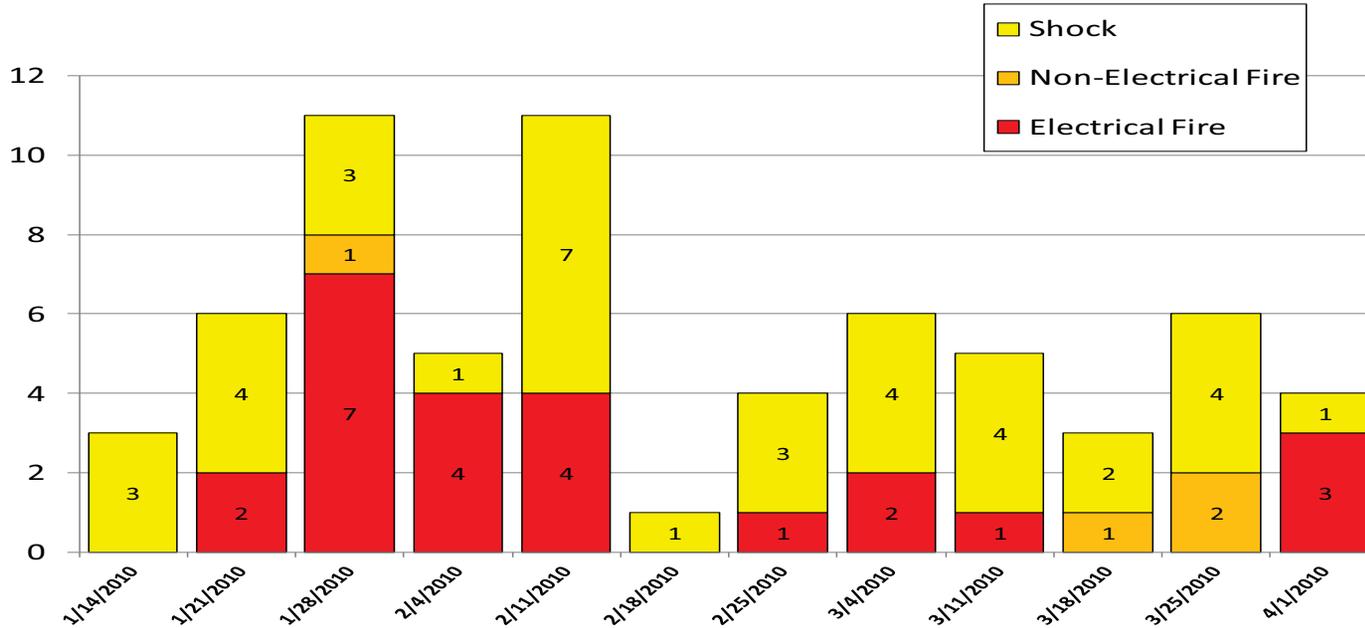

Weekly Comparison

	Week of 4/1/2010	12-Wk Avg
Electrical Fire	3 ↑	2.00
Non-Electrical Fire	0 ↓	0.33
Total Fires	3 ↑	2.33
Shock	1 ↓	3.08

Below 12-wk Average ↓
 Above 12-wk Average ↑

UNCLASSIFIED//~~FOUO~~




UNCLASSIFIED//~~FOUO~~



BLAST FROM THE PAST

Weekly Electric and Fire Incidents (Live)

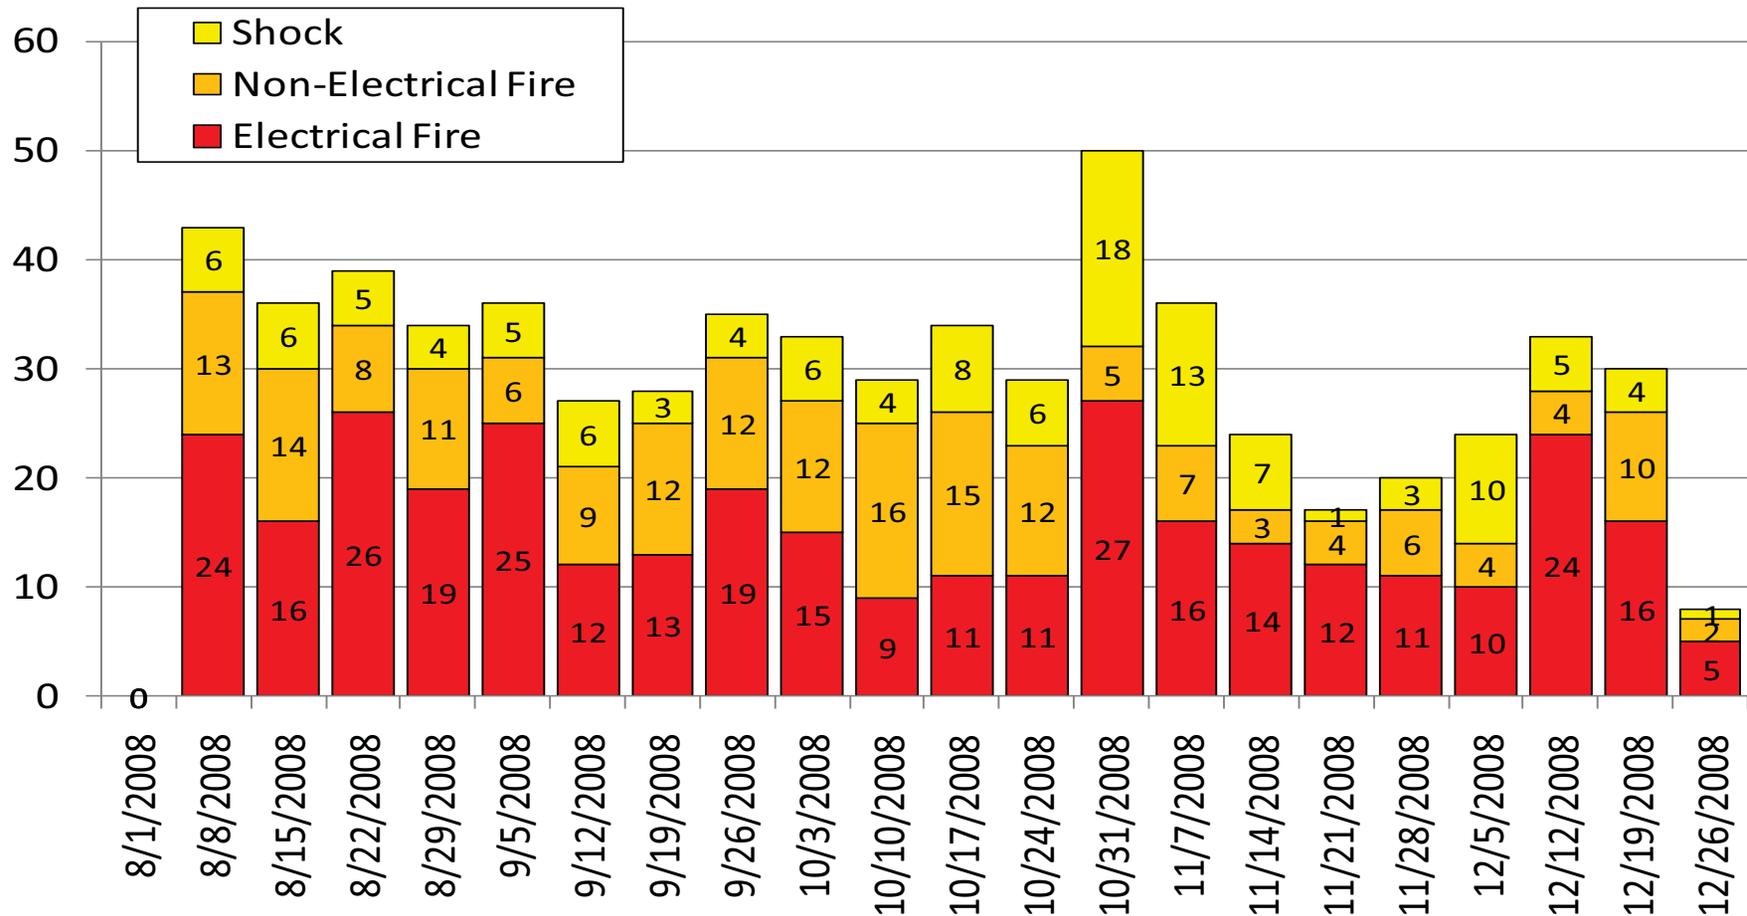

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INSPECTION SUMMARY

INITIAL INSPECTIONS							
QC DATA REPORTING PERIOD (MAR 17 - MAR 23)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE	FACILITIES WITH UN-MITIGATED FLASHES
PHASE 1 INITIAL INSPECTIONS AS OF MAR 30	114,415	66,247	27,603	20,565	57.90%	75.87%	
PHASE 2 INITIAL INSPECTIONS AS OF MAR 30	17,952	14,819	1,007	2,126	82.55%	94.39%	2,186
REINSPECTIONS							
QC DATA REPORTING PERIOD (MAR 17 - MAR 23)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE	FLASHED FACILITIES READY FOR RE-INSPECTION
PHASE 1 RE-INSPECTIONS AS OF MAR 30	36,700	30,913	2,088	3,699	84.23%	94.31%	
PHASE 2 RE-INSPECTIONS AS OF MAR 30	1,396	1,310	37	49	93.84%	97.35%	292


UNCLASSIFIED//~~FOUO~~



~~UNCLASSIFIED/FOUO~~



TOTAL INSPECTION RATES

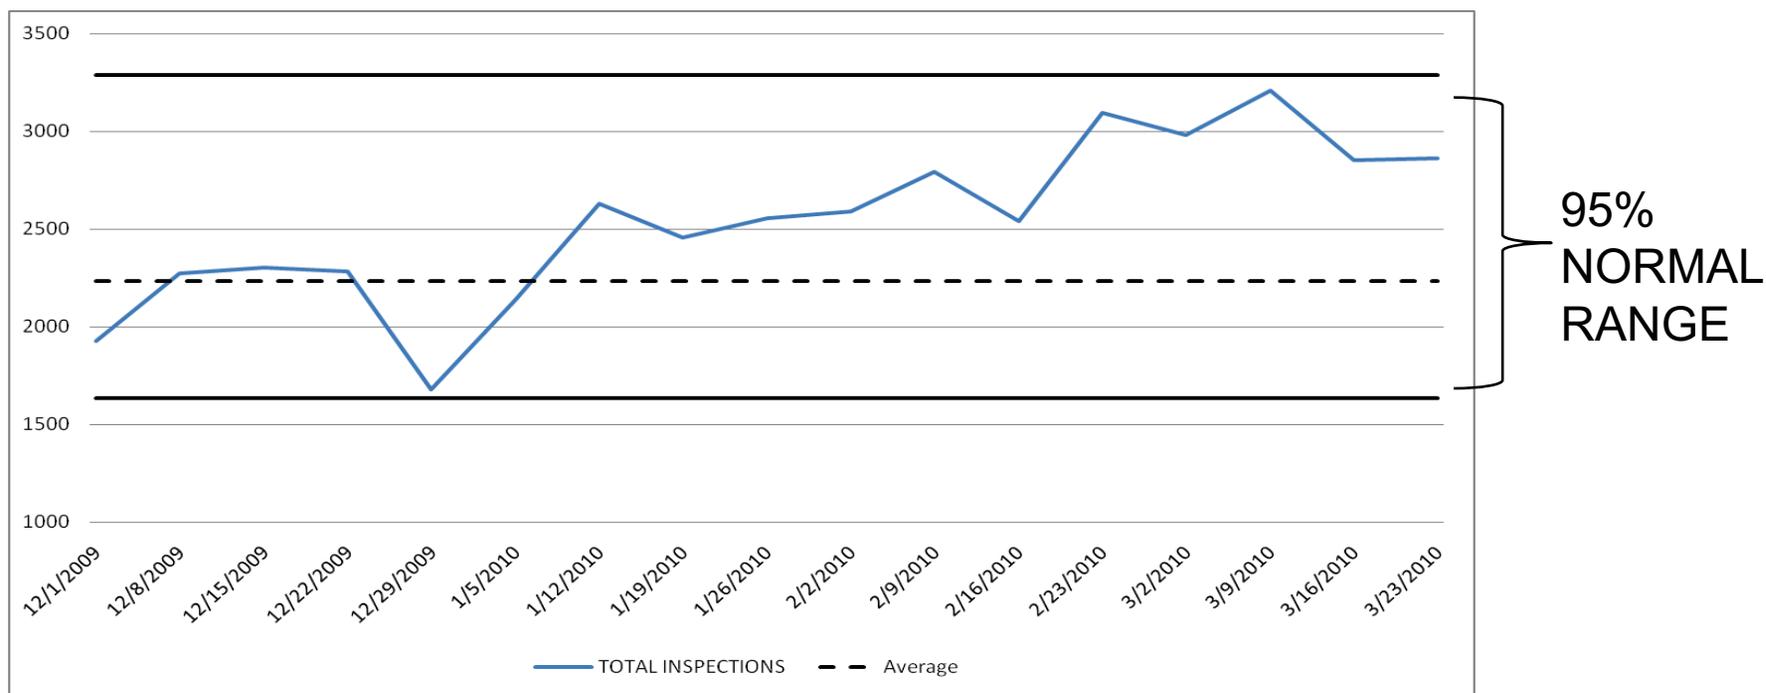

QC DATA REPORTING PERIOD (MAR 17 - MAR 23)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE
PHASE 1	679	528	55	96	77.76%	91.90%
PHASE 2	2,182	1,813	150	219	83.09%	93.13%


~~UNCLASSIFIED/FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

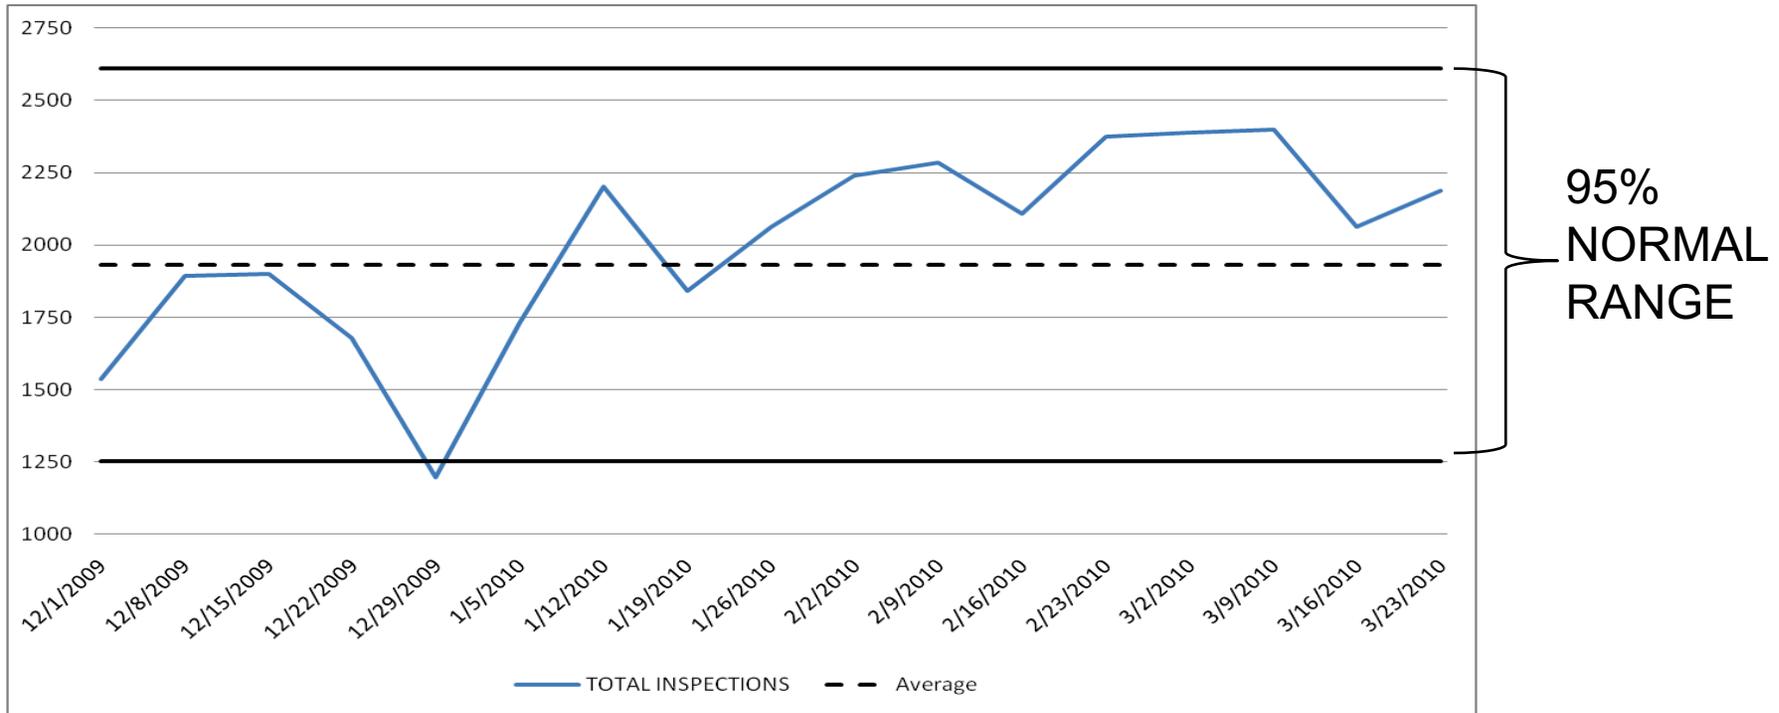


QC DATA REPORTING PERIOD (MAR 17 - MAR 23)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE
PHASE 1	236	109	46	81	46.19%	80.51%
PHASE 2	1,952	1,588	150	214	81.35%	92.32%

UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

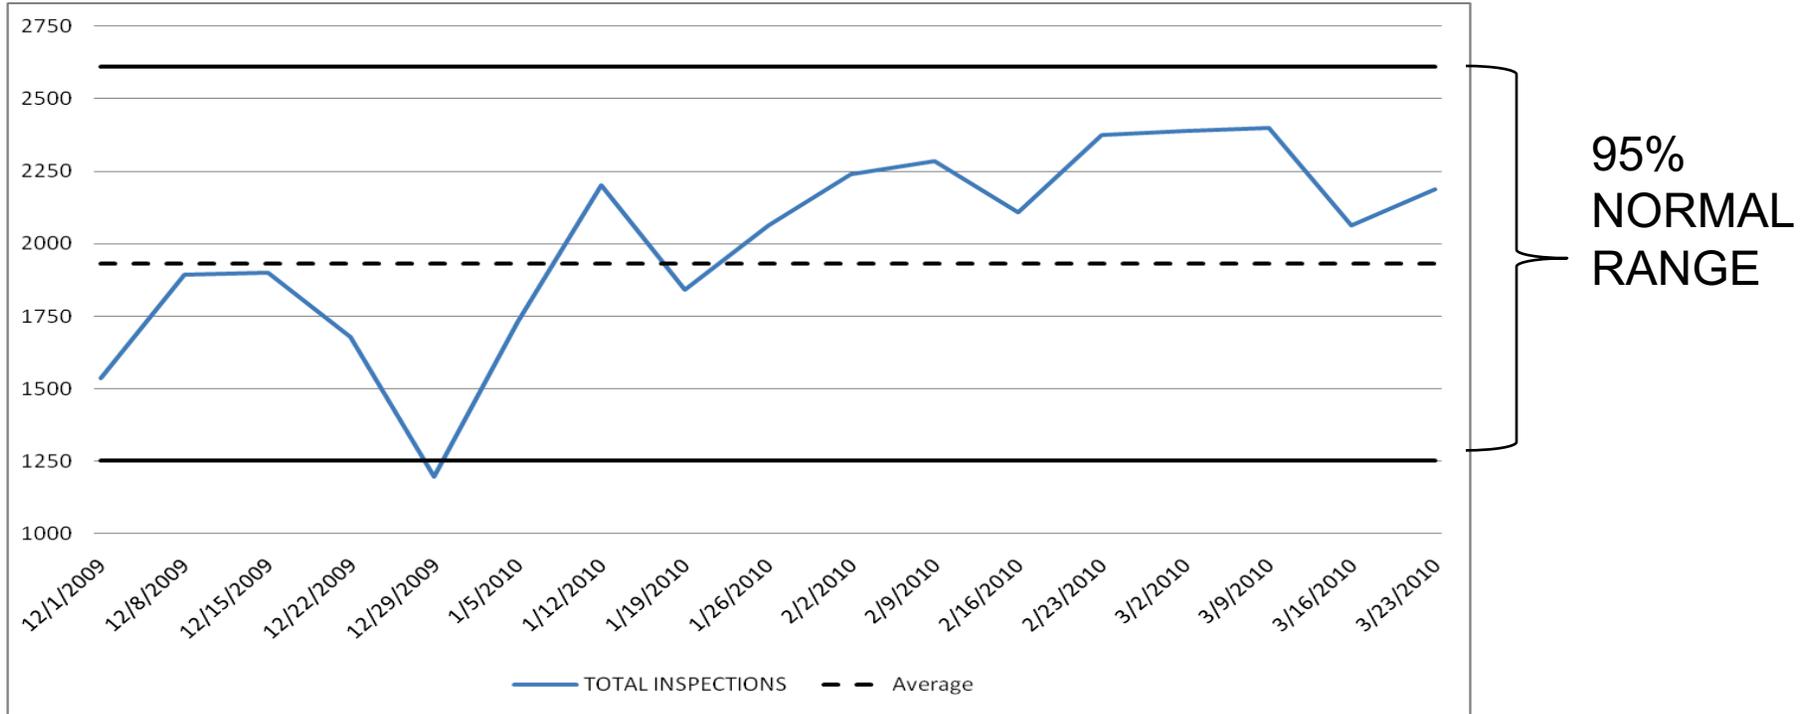


QC DATA REPORTING PERIOD (MAR 17 - MAR 23)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE
PHASE 1	443	419	9	15	94.58%	97.97%
PHASE 2	230	225	0	5	97.83%	100.00%



UNCLASSIFIED//~~FOUO~~



UN-MITIGATED FLASHES

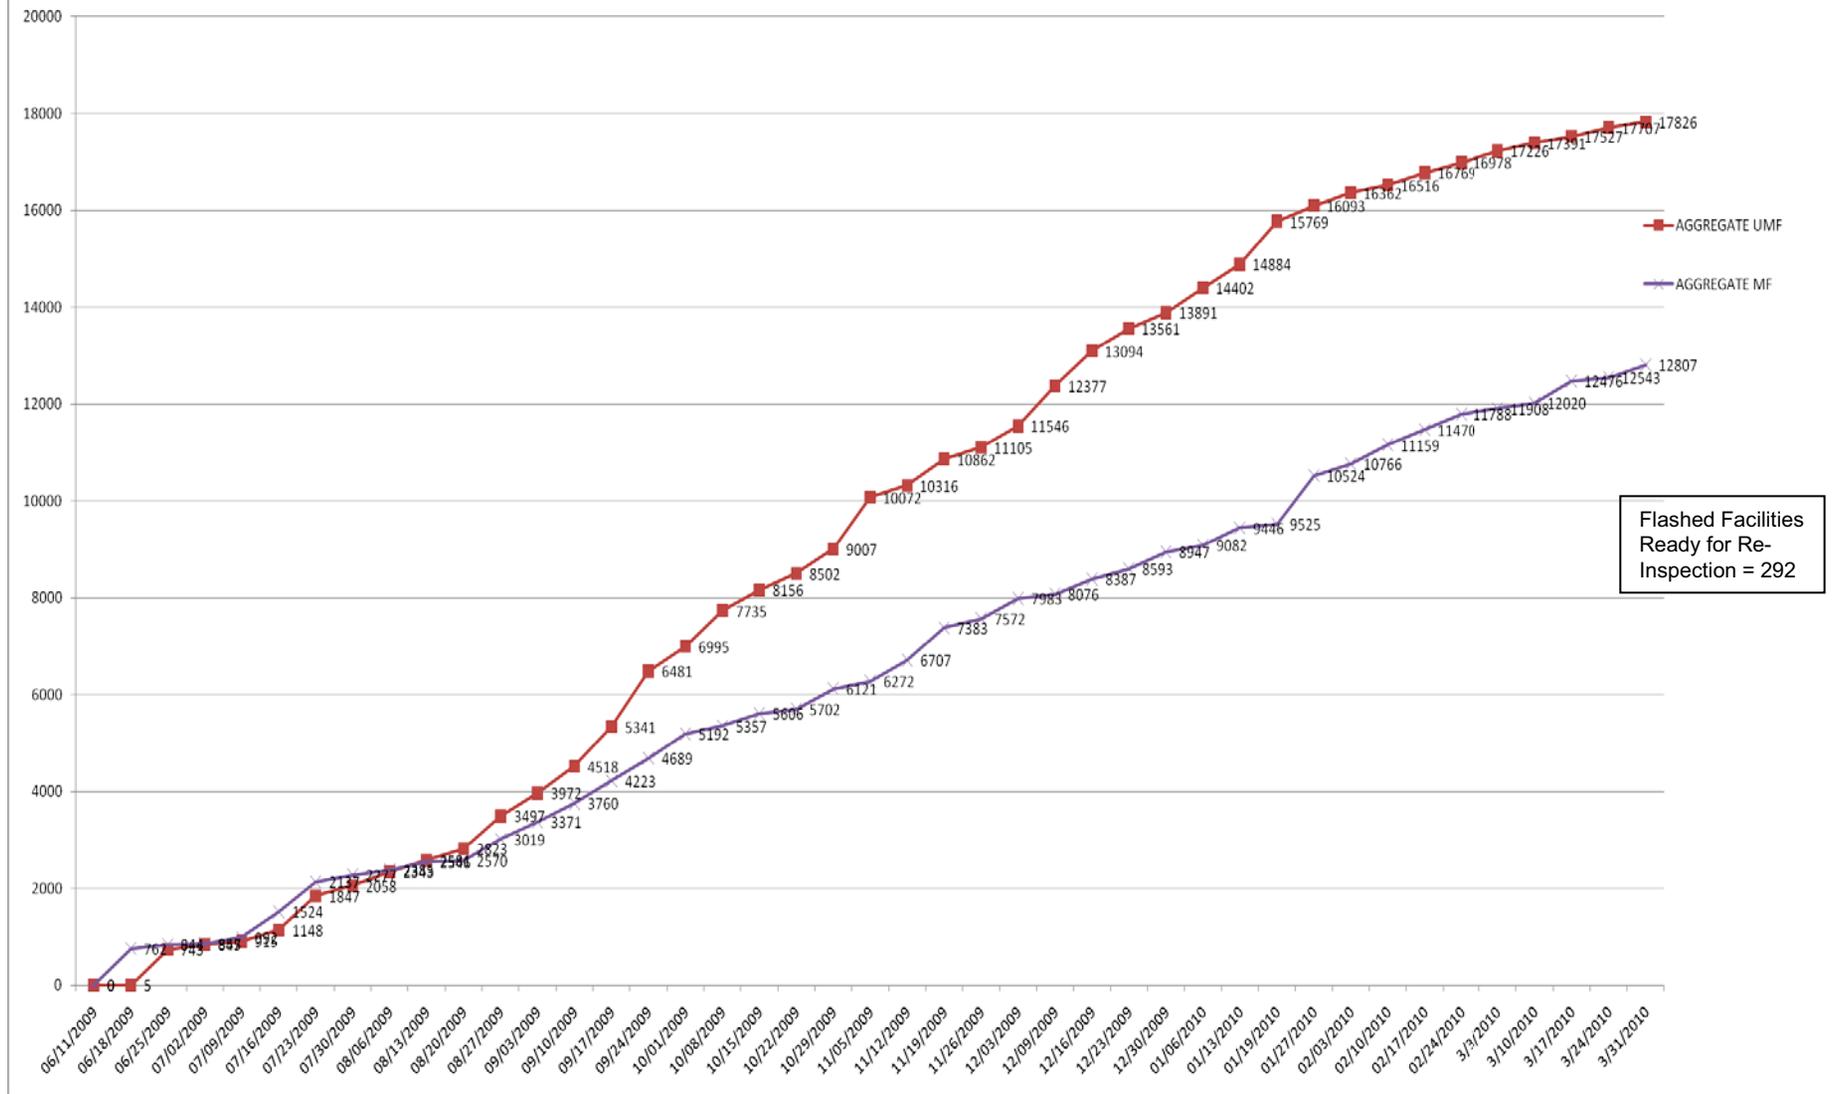

Flashed Facilities Ready for Re-Inspection = 292

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION LHS PASS RATES

	TOP 5 FACILITY TYPES		ALL FACILITY TYPES	
	Phase 1	Phase 2	Phase 1	Phase 2
CENTER	78.02%	96.53%	75.38%	95.57%
SOUTH	84.38%	95.63%	82.54%	93.36%
NORTH	75.12%	96.32%	73.10%	93.99%

TOP 5 FACILITY TYPES
CHU
ABLUTION
GENERATOR
MDP
DP

UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments

	Total Camps	Initially Assessed by TF SAFE	SAT	UNSAT	Pass %	Re-assessed	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	100	75	35	40	47%	11	11	0	100%	8
All Others	271	220	43	177	20%	50	31	19	62%	23
Total	371	295	78	217	26%	61	42	19	69%	31

- Camps Assessed 25 Mar-1 APR 10= 29
 - 18 UNSAT
 - 11 SAT
- Camps Re-assessed 25 Mar-1APR 10=37
 - 15 UNSAT
 - 22 SAT
- Camps remaining to be assessed: 45

- Camps added over last week: 23
- Camps removed: 4
 - No Longer There
- * Two of the camps removed were previously assessed



UNCLASSIFIED//~~FOUO~~



Inglett & Stubbs Progress Report

Division (# of Repair Teams)	"FLASH" Defects Repaired From SBH Inspection Reports	LHS Defects Repaired by Special Request	Facilities Assessed by Special Request	Defects Repaired This Period	Total Defects Repaired
USD-C (2)	92	14	1	0	106
USD-S (3)	6	3	11	0	9
USD-N (5)	103	0	1	14	103
TOTALS	201	17	13	14	218
USD-C	LOCATION	STATUS			
TEAM 3	IZ/Union III	Repairing LHS deficiencies at re-located LSA			
TEAM 8	VBC	Performing "FLASH" repairs			
USD-S					
TEAM 1	Garry Owen	Performing "FLASH" repairs			
TEAM 7	Garry Owen	Performing "FLASH" repairs			
TEAM 9	Tallil	Preparing to relocate to Speicher to fill Team 6 vacancy			
USD-N					
TEAM 2	JB Balad	Performing "FLASH" repairs			
TEAM 4	Ninewa Prov.	Performing LHS repairs at 13 DIBs CCPs			
TEAM 5	Ninewa Prov.	Performing LHS repairs at 13 DIBs CCPs			
TEAM 6	Speicher	Performing "FLASH" repairs			
TEAM 10	JB Balad	Performing "FLASH" repairs			

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~




FIRE CHIEF'S REPORT

ORI Pass -	1 st	2 nd	3 rd
<u>Kalsu</u> -	87.2% - 86.9% - 98.0%		
Fire Fighting Drills-	85.0%	91.5%	100%
Administrative -	87.8%	85.0%	97.2%



➤ ORI Team is moving to Echo this week.

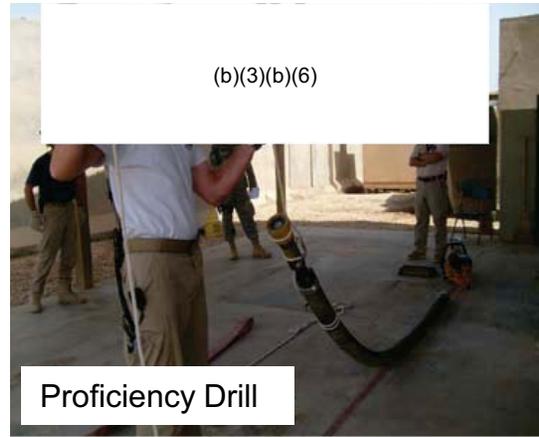

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 04/02
Awareness	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	USF-I PAO conduct interviews with TF SAFE Chief, Deputy Chief, Master Electrician, Fire Chief, and SGM. Rotate TF SAFE personnel to AFN Freedom Radio on Thursdays. Ongoing (***)?	USF-I Safety	***
	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	USF-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets. Now running!	Submitted as Needed (***) Regenerate w/photos	USF-I Safety	***
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	USF-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Safety officers, Mayor's cells and AAFES PX system- in place Country wide	Continue surveillance for compatible electrical items (Liberty PX***)	USF-I Safety	***

UNCLASSIFIED//~~FOUO~~