



UNCLASSIFIED//~~FOUO~~



ONE TEAM

ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

7 May 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



OVERVIEW


- ***FALCON Fire Dept Visit***
- ***Contractor Camp Repair Working Group established***
- ***Brief to DCOS on growing UMF problem***
- ***Electrical safety awareness Article in Victory Times***
- ***Assistant Fire Chief W Protection Specialist (b)(3)(b)(6) deploys. Fire assigned as Acting Asst Fire Chie***

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

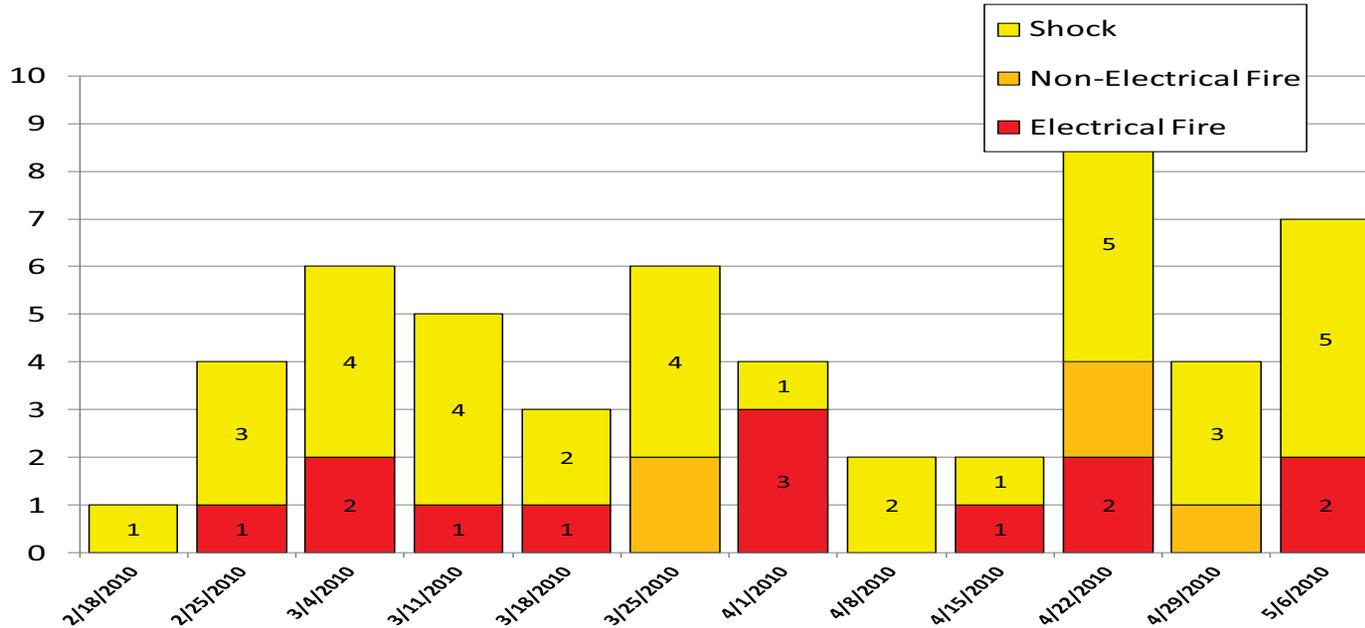

Weekly Comparison

	Week of 5/6/2010	12-Wk Avg
Electrical Fire	2 ↑	1.08
Non-Electrical Fire	0 ↓	0.42
Total Fires	2 ↑	1.50
Shock	5 ↑	2.92

Below 12-wk Average ↓
 Above 12-wk Average ↑

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INSPECTION SUMMARY

INITIAL INSPECTIONS							
	TOTAL	PASSED	FAIL FLASH	FAIL PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 INITIAL INSPECTIONS AS OF MAY 04	115,098	66,592	27,844	20,662	57.86%	75.81%	FACILITIES WITH UN-MITIGATED FLASHES
PHASE 2 INITIAL INSPECTIONS AS OF MAY 04	29,662	24,423	1,666	3,573	82.34%	94.38%	2,133
REINSPECTIONS							
	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 RE-INSPECTIONS AS OF MAY 04	38,705	32,711	2,182	3,812	84.51%	94.36%	FLASHED FACILITIES READY FOR RE-INSPECTION
PHASE 2 RE-INSPECTIONS AS OF MAY 04	2,752	2,595	67	90	94.30%	97.57%	923


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TOTAL INSPECTION RATES

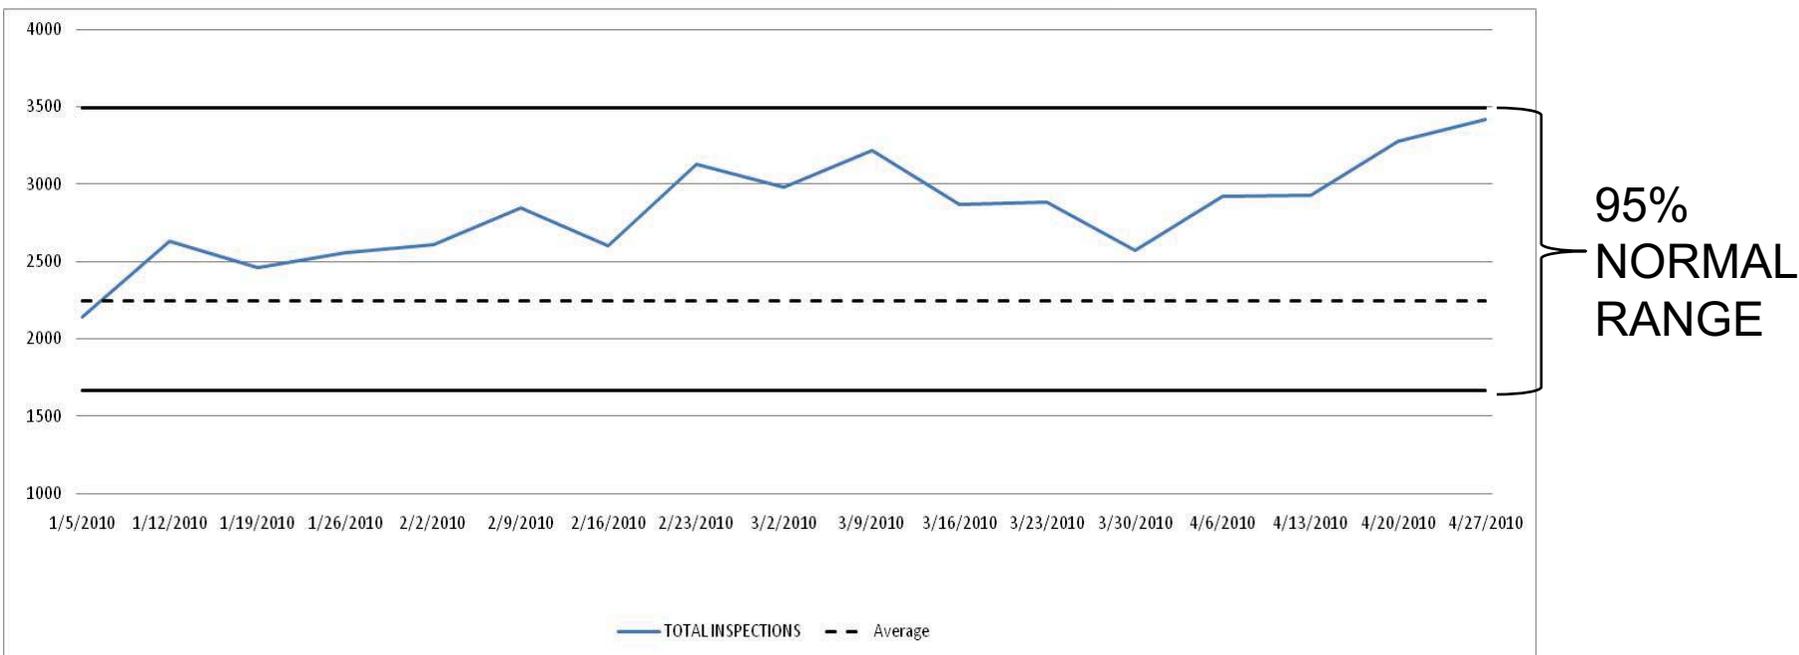

QC DATA REPORTING PERIOD (APR 21 - APR 27)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	517	402	91	24	77.76%	82.40%
PHASE 2	2,899	2,507	122	270	86.48%	95.79%


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

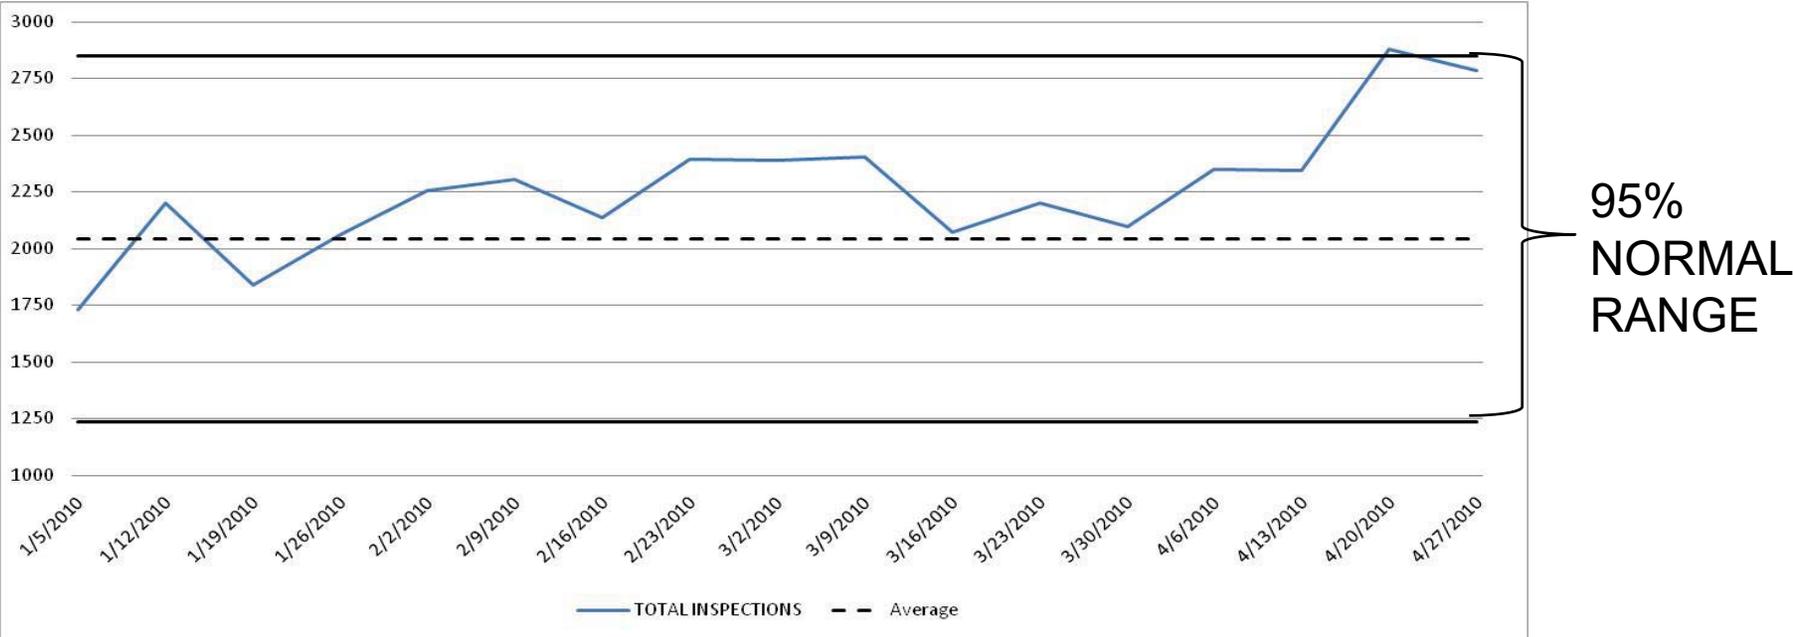


QC DATA REPORTING PERIOD (APR 21 - APR 27)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	156	66	80	10	42.31%	48.72%
PHASE 2	2,625	2,246	116	263	85.56%	95.58%

UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

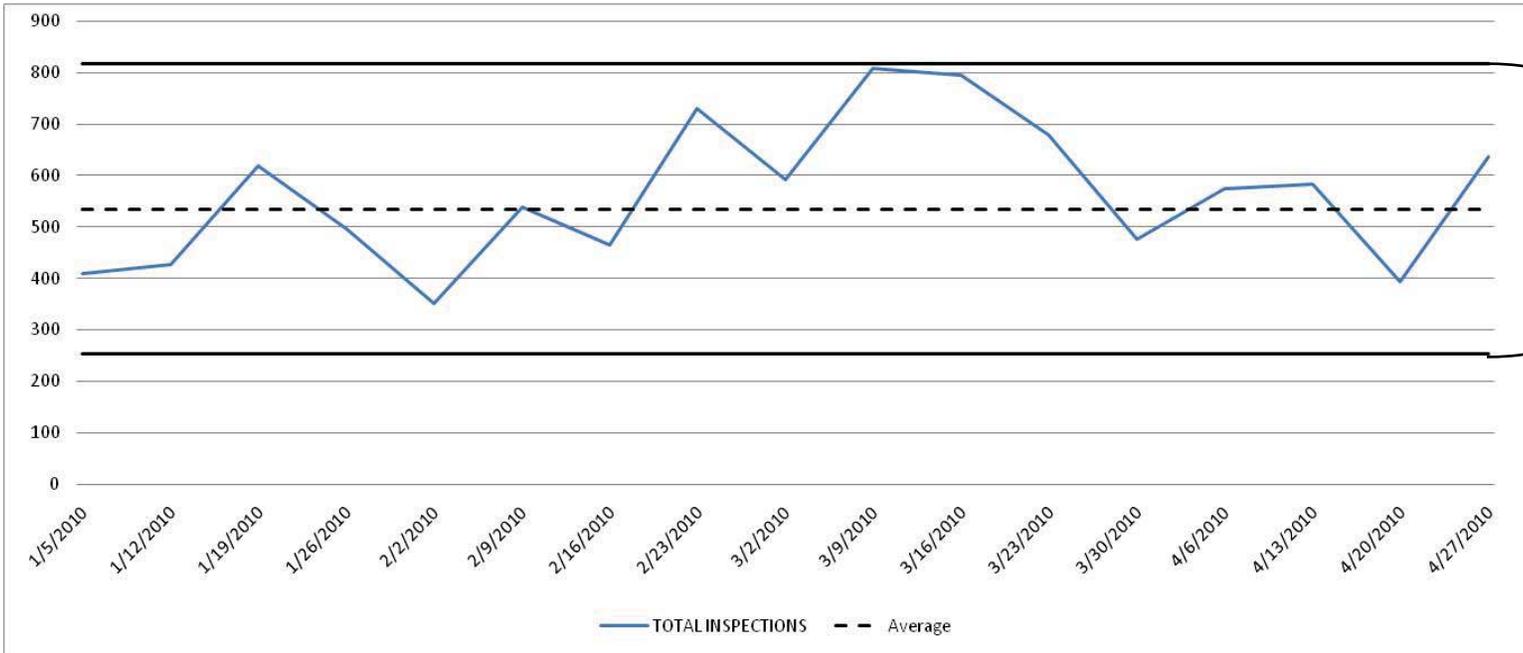


95%
NORMAL
RANGE

QC DATA REPORTING PERIOD (APR 21 - APR 27)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	361	336	11	14	93.07%	96.95%
PHASE 2	274	261	6	7	95.26%	97.81%



UNCLASSIFIED//~~FOUO~~

UN-MITIGATED FLASHES

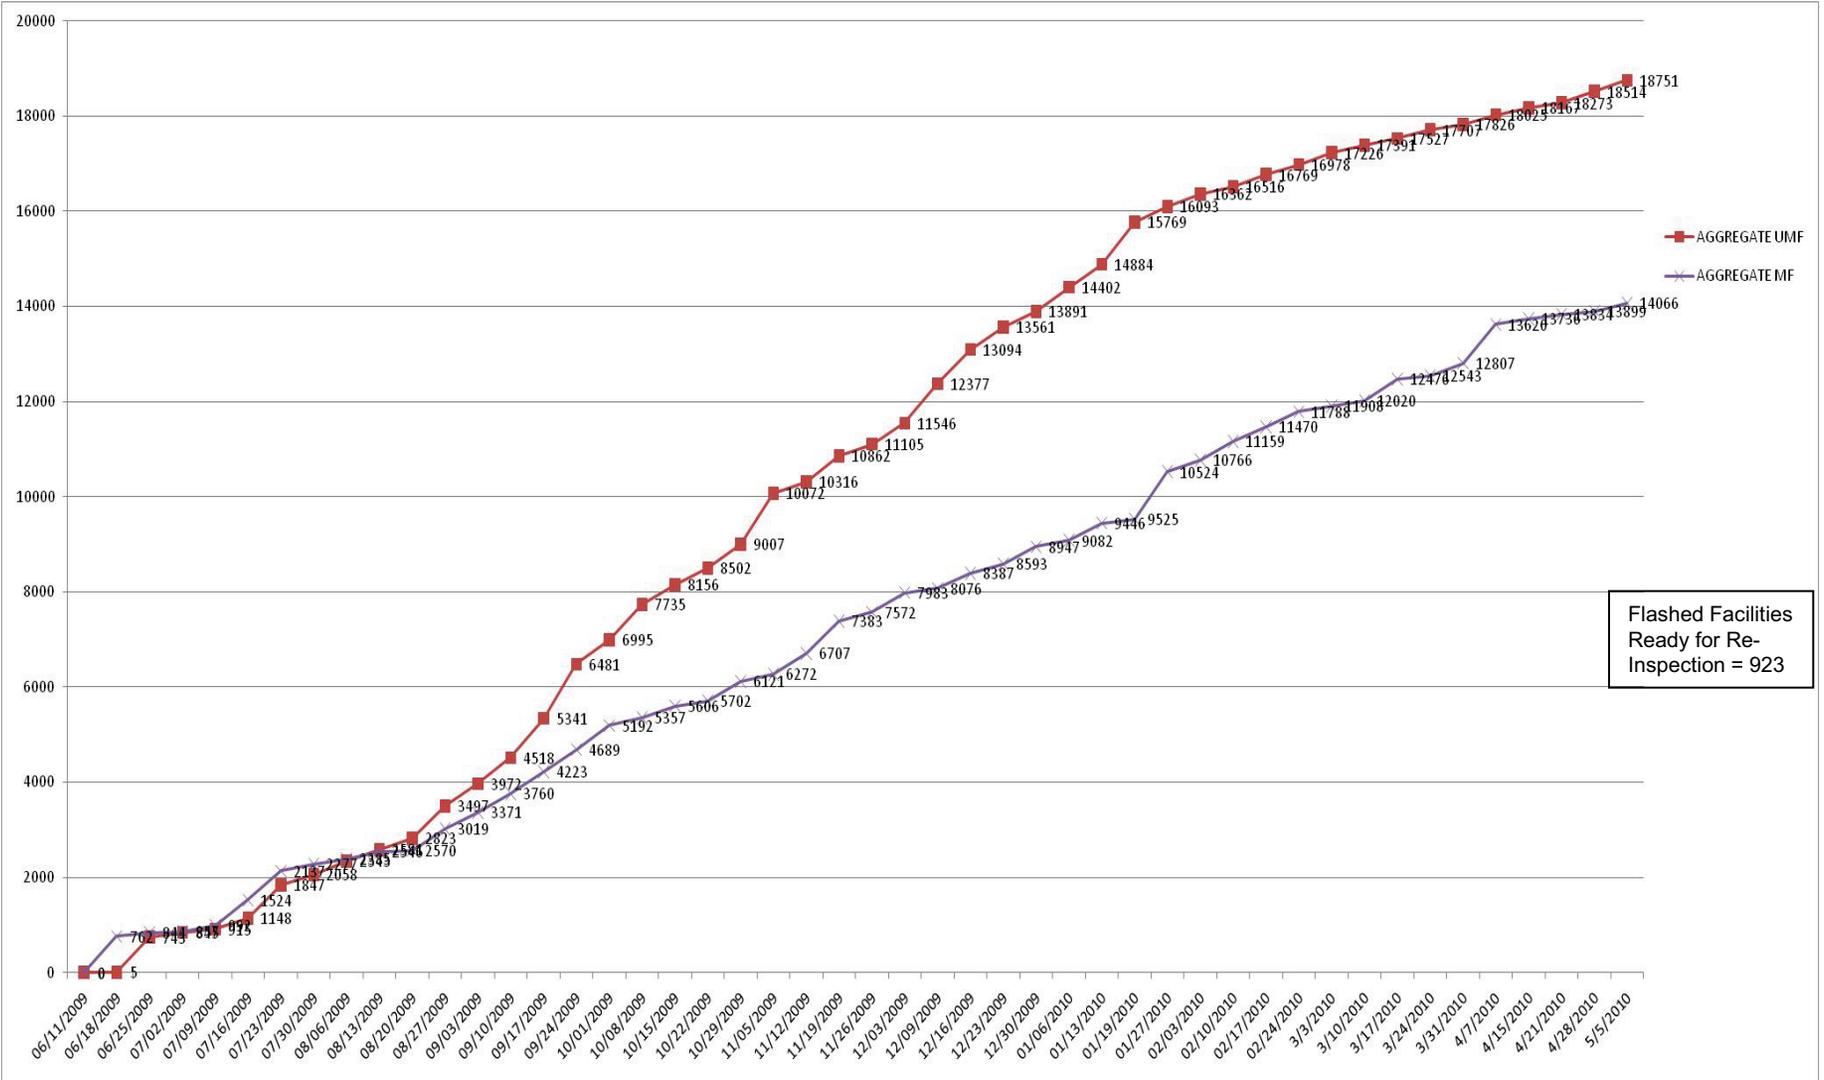

UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments


	Total Camps	Initially Assessed by TF SAFE	SAT	UNSAT	Pass %	2 nd Assessment	SAT	UNSAT	Pass%	3 rd Assessment	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	88	77	37	40	48%	27	23	4	85%	1	1	0	100%	5
All Others	257	230	47	183	20%	93	46	47	49%	9	3	6	33%	24
Total	345	307	84	223	27%	120	69	51	58%	10	4	6	40%	29

- Camps Assessed 29 APR 10-6 MAY 10= 8
 - 6 UNSAT
 - 2 SAT
- Camps Re-assessed 29APR 10-6 MAY 10=23
 - 12 UNSAT
 - 11 SAT
- Camps remaining to be assessed: 9

- Camps added over last week: 5
- Camps removed: 4
 - 3 No Longer There
 - 1 Base Closure
- * Two camps removed were previously assessed



UNCLASSIFIED//~~FOUO~~



Inglett & Stubbs Progress Report

Division (# of Repair Teams)	"FLASH" Defects Repaired From SBH Inspections (REPORTS)	LHS Defects Repaired by Special Request (LOCATIONS)	Facilities Assessed by Special Request	Defects Repaired This Period	Total Defects Repaired
USD-C (3)	154	25	5	17	179
USD-S (2)	78	3	13	0	81
USD-N (5)	164	5	16	29	169
TOTALS	396	33	34	46	429
USD-C	LOCATION	STATUS			
TEAM 3	VBC	Performing "FLASH" Repairs			
TEAM 6	Najaf ODA Camp	Repairs Complete - Awaiting Movement Back to VBC			
TEAM 8	VBC	Performing "FLASH" Repairs			
USD-S					
TEAM 1	Tallil	Refitting for Movement to Kalsu - Scheduled for 10 May 2010 Awaiting Return of Trailer and Container from Garry Owen			
TEAM 7	Tallil				
USD-N					
TEAM 2	JB Balad	Performing "FLASH" Repairs			
TEAM 4	Marez	Completed Repairs at CCPs 1 & 5 Awaiting Movement to Next CCP			
TEAM 5	Marez				
TEAM 9	JB Balad	Performing "FLASH" Repairs			
TEAM 10	Speicher	Performing "FLASH" Repairs			

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



FIRE CHIEF'S REPORT


Regional Fire Protection Specialist (RFPS) Activities

WSLEC and TF SAFE

January 2010 to Present FALCON FIRE DEPARTMENT



Award Ceremony
Locations Visited

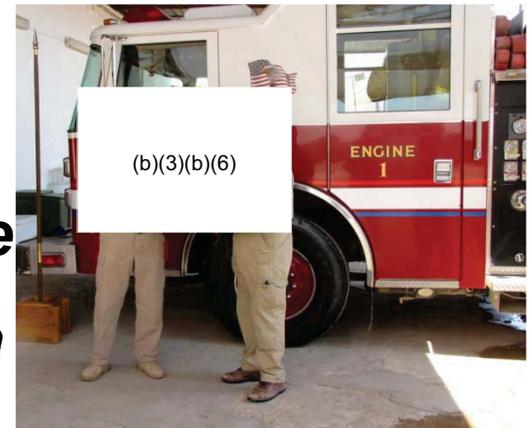

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 07 May
	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	<i>USF-I PAO conducted PSA session / inteth TF SAFE's SFC(b)(3), (b)(6) on 20 Apr 2010. More to ith another PSA.</i>	USF-I Safety	XXXX
Awareness	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	USF-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets. Now running!	<i>Pending submitting to TF Safe Safety for vetting.</i>	USF-I Safety	XXXX
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	USF-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Safety officers, Mayor's cells and AAFES PX system- in place Country wide	Continue surveillance for compatible electrical items.	USF-I Safety	

UNCLASSIFIED//~~FOUO~~