



UNCLASSIFIED//~~FOUO~~



ONE TEAM

ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

12 February 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



OVERVIEW


- **MAJ** (b)(3)(b)(6) ***new TF SAFE Deputy arrives***
- ***Assist visit to TF POWER-Afghanistan Feb 14-20***
- ***Repair Trailer pre-positioned in IZ for IHEC repairs (if necessary)***
- ***Magnetic Ballast Prohibition change submitted to CENTCOM SANDBOOK***
- ***Electrical Awareness Course held***

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

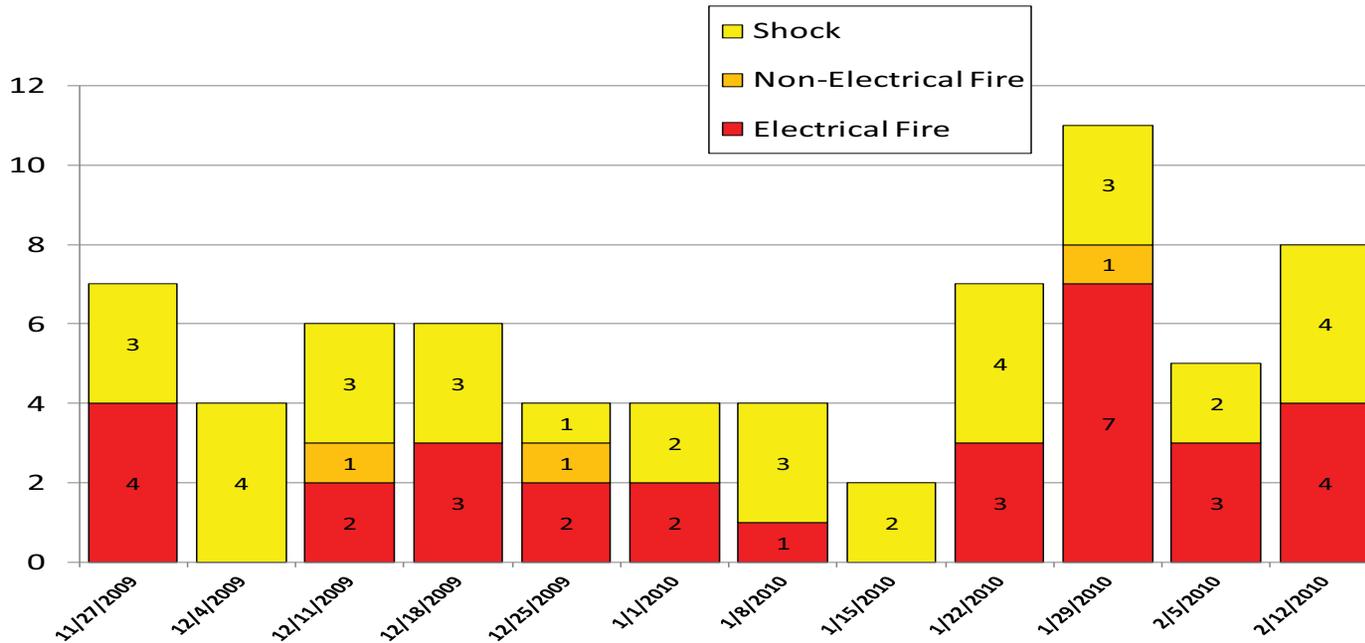

Weekly Comparison

	Week of 2/12/2010	12-Wk Avg
Electrical Fire	4 ↑	2.58
Non-Electrical Fire	0 ↓	0.25
Total Fires	4 ↑	2.83
Shock	4 ↑	2.83

Below 12-wk Average ↓
 Above 12-wk Average ↑

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INSPECTION SUMMARY

INITIAL INSPECTIONS							
	TOTAL	PASSED	FAIL FLASH	FAIL PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 INITIAL INSPECTIONS AS OF FEB 09	113,026	65,060	27,481	20,485	57.56%	75.69%	FACILITIES WITH UN-MITIGATED FLASHES
PHASE 2 INITIAL INSPECTIONS AS OF FEB 09	5,160	4,421	313	426	85.68%	93.93%	2,304
REINSPECTIONS							
	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 RE-INSPECTIONS AS OF FEB 09	33,646	28,084	2,005	3,557	83.47%	94.04%	FLASHED FACILITIES READY FOR RE-INSPECTION
PHASE 2 RE-INSPECTIONS AS OF FEB 09	161	156	4	1	96.89%	97.52%	755


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TOTAL INSPECTION RATES

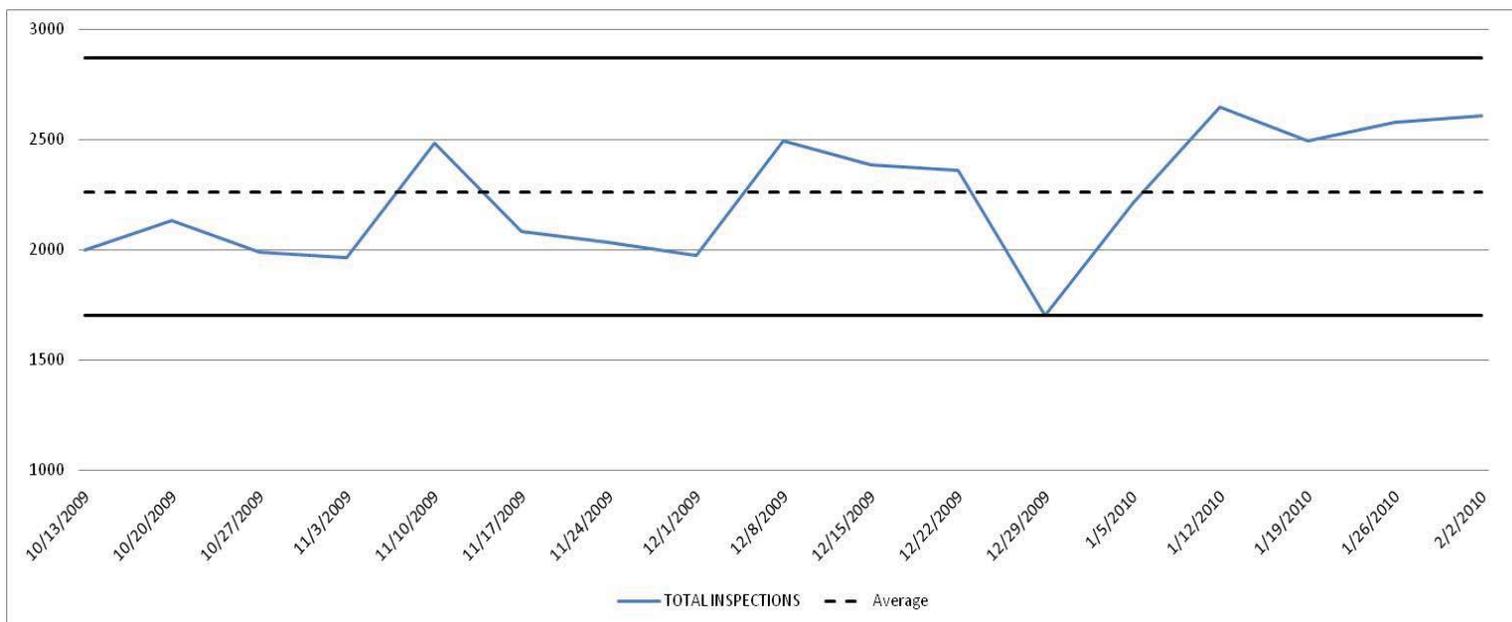

95%
NORMAL
RANGE

QC DATA REPORTING PERIOD (JAN 27 - FEB 02)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	1,581	1,096	245	240	69.32%	84.50%
PHASE 2	1,023	777	81	165	75.95%	92.08%


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

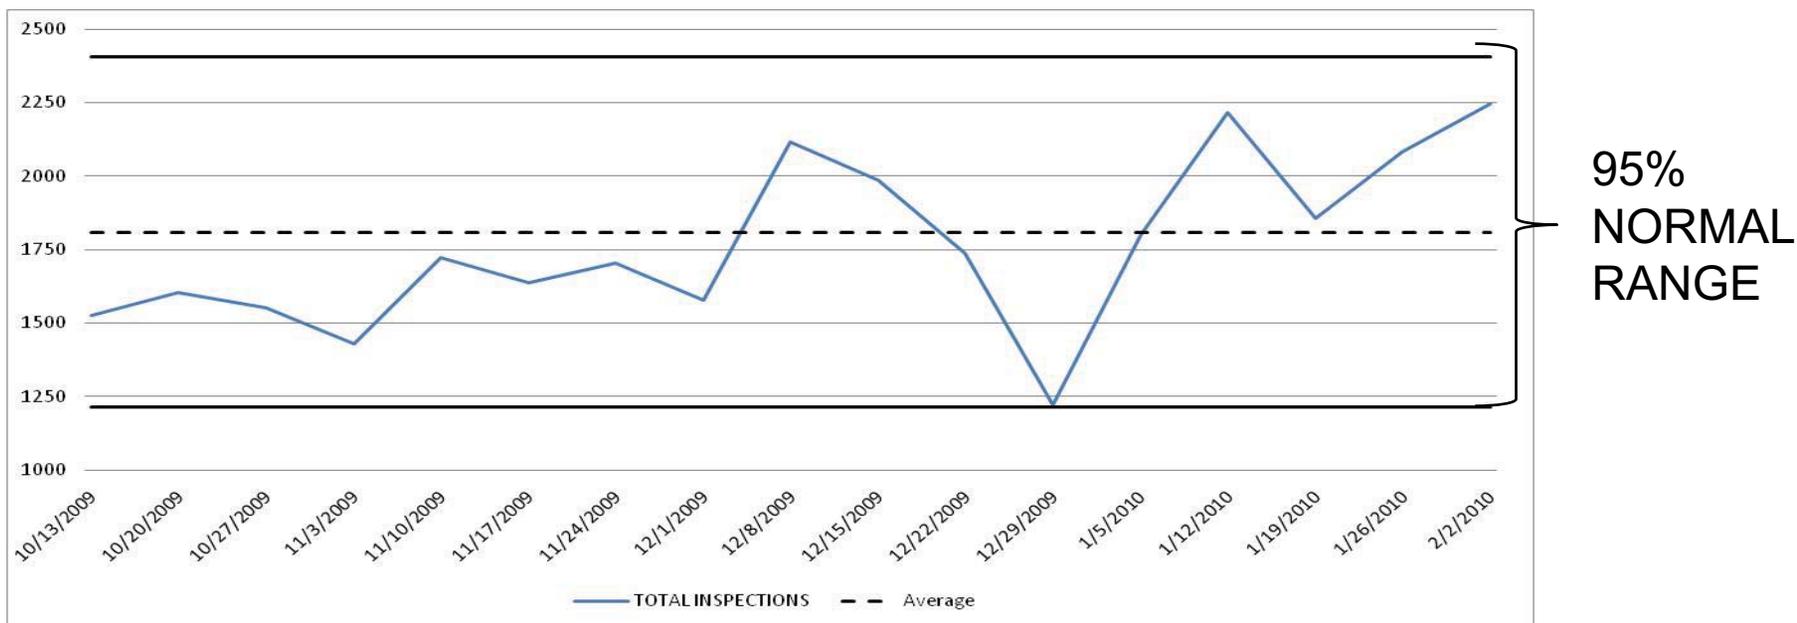


QC DATA REPORTING PERIOD (JAN 27 - FEB 02)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	1,260	798	236	226	63.33%	81.27%
PHASE 2	985	742	78	165	75.33%	92.08%

UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

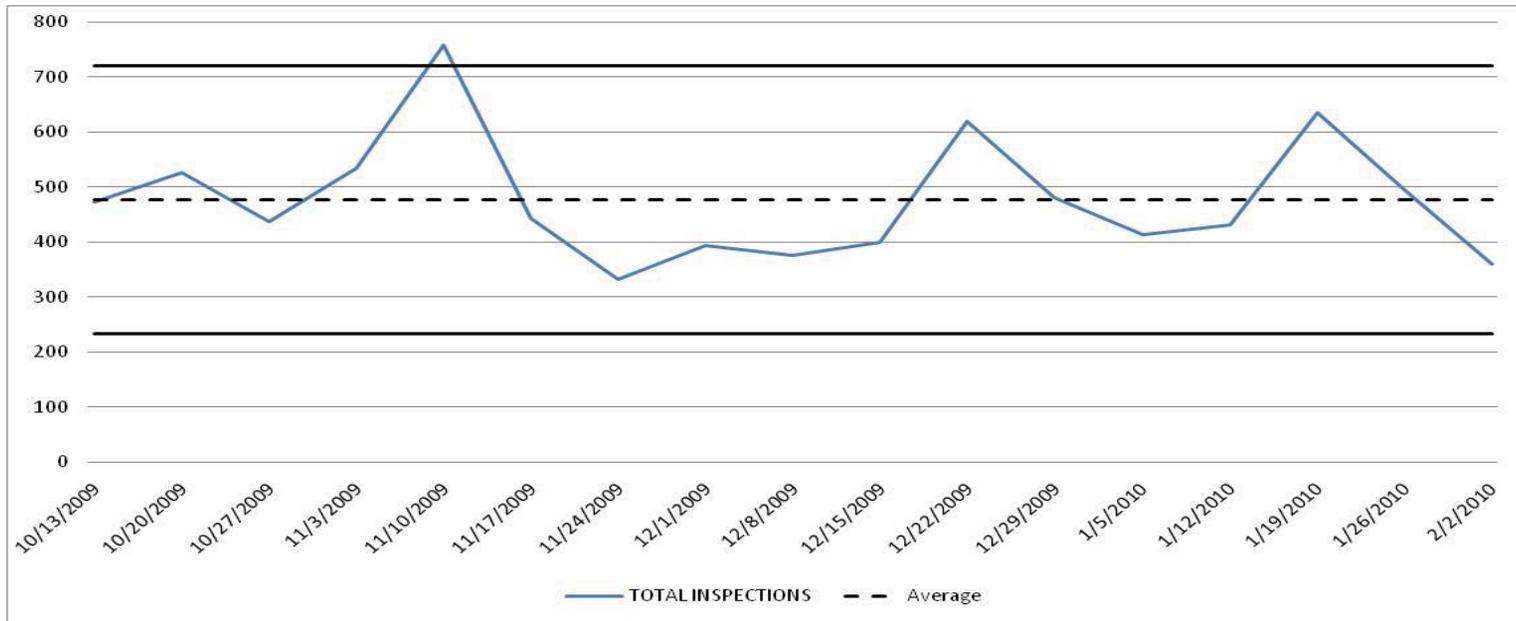


95%
NORMAL
RANGE

QC DATA REPORTING PERIOD (JAN 27 - FEB 02)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	321	298	9	14	92.83%	97.20%
PHASE 2	38	35	3	0	92.11%	92.11%



UNCLASSIFIED//~~FOUO~~

UN-MITIGATED FLASHES

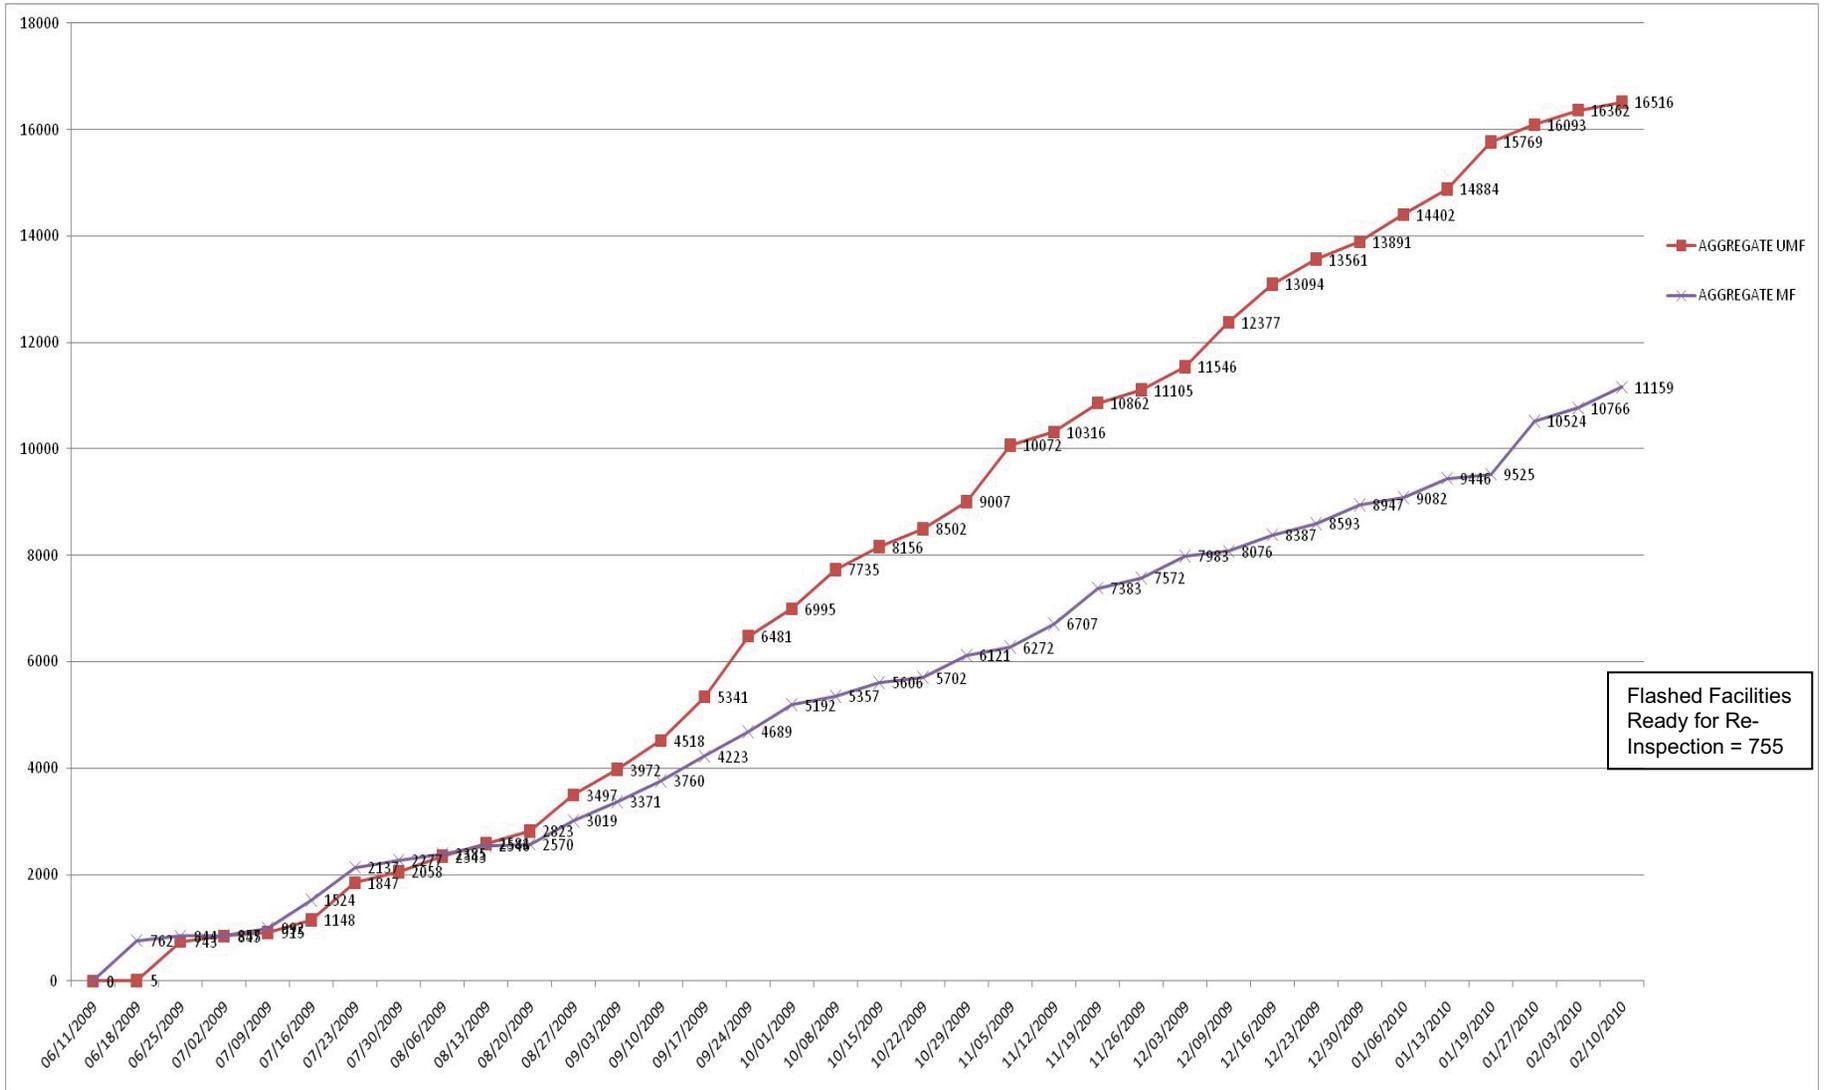

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION LHS PASS RATES

	TOP 5 FACILITY TYPES		ALL FACILITY TYPES	
	PHASE 1	PHASE 2	PHASE 1	PHASE 2
CENTER	77.62%	97.76%	75.06%	97.13%
SOUTH	83.61%	97.25%	82.20%	95.84%
NORTH	74.94%	94.46%	73.03%	91.32%

TOP 5 FACILITY TYPES
CHU
ABLUTION
GENERATOR
MDP
DP

UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments

	Total Camps	Initially Assessed by TF SAFE	SAT	UNSAT	Pass %	Re-assessed	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	104	65	31	34	48%	1	1	0	100%	8
All Others	274	153	27	126	18%	12	10	2	83%	17
Total	378	218*	58	160	27%	13	11	2	85%	25

- Camps Assessed Week of 5-11 Feb 10 = 3
 - 0 SAT
 - 3 UNSAT

▪ Camps remaining to be assessed: 135

*One camp removed had a previous UNSAT assessment

- Camps added over last week: 13
 - Identified by JCCI/A: 11
 - Identified by TF SAFE: 1
 - Self-Identified: 1

- Camps removed: 2*
 - Administratively removed: 0
 - No longer there: 2



UNCLASSIFIED//~~FOUO~~



Inglett & Stubbs Repair Progress

	Total Locations	Complete Locations	Remaining Locations	Facilities Complete	% Complete	Projected Completion Date	Un-Mitigated Flash (UMF) Deficiencies Repaired	Number of Repair Teams
USD-C Baghdad	60	57	3	1210	95%	2/26/2010	60	2
USD-S	34	34	0	1043	100%	COMPLETE	2	3
USD-N	65	62	3	1059	95%	2/26/2010	16	5
USD-C	35	35	0	1016	100%	COMPLETE	0	0
TOTALS	194	188	6	4328	97%	FEB 2010	78	10

USD-C Baghdad	LOCATION	STATUS
TEAM 3	VBC	Performing UMF repairs - Positioned material trailer in IZ for IHEC Awaiting movement coordination to Istiqlal to make repairs (assessment complete)
TEAM 8	VBC	
USD-S		
TEAM 1	R&R	Return expected 19 FEB 2010
TEAM 7	Camp Ur	Approved re-visit due to reports of deterioration in electrical system integrity
TEAM 9	Camp Ur	
USD-N		
TEAM 2	JB Balad	Performing UMF repairs while awaiting movement to next location
TEAM 4	JB Balad	
TEAM 5	Nimr	Performing LHS assessments & repairs of 11 facilities
TEAM 6	Speicher	Performing UMF repairs while awaiting movement to next location
TEAM 10	Speicher	Performing UMF repairs while awaiting movement to next location

UNCLASSIFIED//~~FOUO~~




UNCLASSIFIED//~~FOUO~~



FIRE CHIEF'S REPORT

Fire Prevention Visits (JSS)

- ◆ Gary Owen (Maysan, Yomiyen, Shaheen, Ararrah)
- ◆ Al Asad (Ubaydi)
- ◆ Hammer, Taji
- ◆ Echo, Kalsu
- ◆ IZ (UR)
- ◆ ORI Team is at IZ

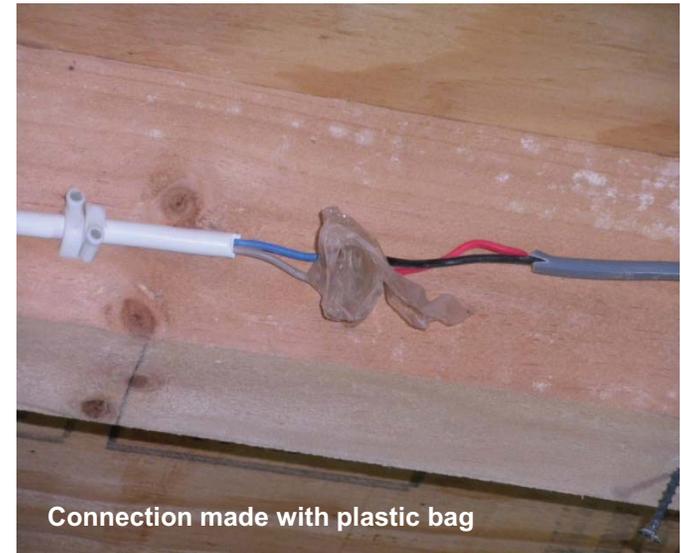

Connection made with plastic bag



Daisy chain of extension cords made with scotch tape



Electrical short of wall outlet



Connection made with scotch tape

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 02/12
Awareness	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	USF-I PAO conduct interviews with TF SAFE Chief, Deputy Chief, Master Electrician, Fire Chief, and SGM. Rotate TF SAFE personnel to AFN Freedom Radio on Thursdays. Ongoing	USF-I Safety	
	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	USF-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets. Now running!	Submitted as Needed	USF-I Safety	
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	USF-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Safety officers, Mayor's cells and AAFES PX system- in place Country wide	Continue surveillance for compatible electrical items	USF-I Safety	

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



THIS CHU WAS FOUND IN THEATER THIS MONTH



UNCLASSIFIED//~~FOUO~~