



UNCLASSIFIED//~~FOUO~~



ONE TEAM

ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

12 March 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~




OVERVIEW

- **TF SAFE funding through July 2011 approved at SuperCARB board**
- **CAPT (b)(3)(b)(6) Tallil teams visit and Bldg 505 site visit**
- **TF SAFE ongoing or planned repairs:**
 - **Unio ast LSA**
 - **COL (b)(3)(b)(6)**
 - **oint**
 - **(b)(6)**
 - **(b)(3)(b)(6)**
 - **Cam**
- **Redeployed: (b)(6) SME an (b)(3)(b)(6) Program Man ad SME (b)(3)(b)(6)**
- **Welcome aboard: SPC (b)(3)(b)(6) – New Admin Specialist**



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

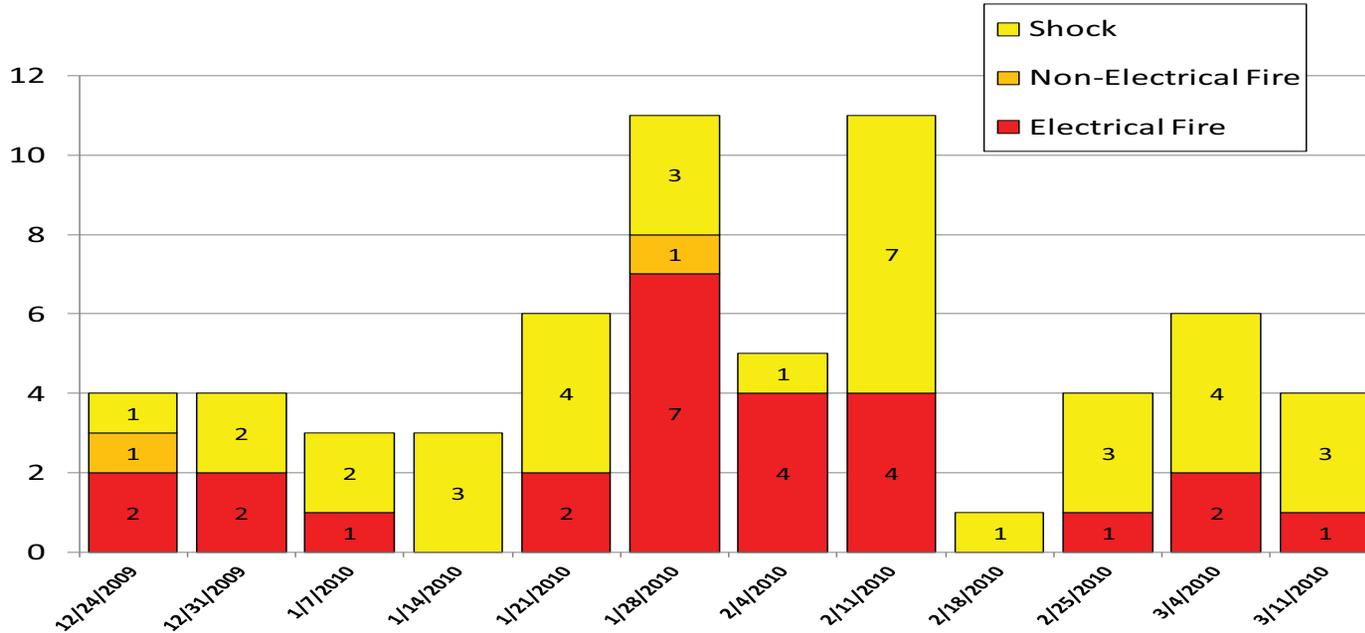

Weekly Comparison

	Week of 3/11/2010	12-Wk Avg
Electrical Fire	1	2.17
Non-Electrical Fire	0	0.17
Total Fires	1	2.33
Shock	3	2.83

Below 12-wk Average
 Above 12-wk Average

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~




INSPECTION SUMMARY

INITIAL INSPECTIONS							
QC DATA REPORTING PERIOD (FEB 24 - MAR 02)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE	FACILITIES WITH UN-MITIGATED FLASHES
PHASE 1 INITIAL INSPECTIONS AS OF MAR 09	113,827	65,777	27,555	20,495	57.79%	75.79%	
PHASE 2 INITIAL INSPECTIONS AS OF MAR 09	12,243	10,042	706	1,495	82.02%	94.23%	2271
REINSPECTIONS							
QC DATA REPORTING PERIOD (FEB 24 - MAR 02)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	17	FLASHED FACILITIES READY FOR RE-INSPECTION
PHASE 1 RE-INSPECTIONS AS OF MAR 09	35,261	29,566	2,058	3,637	83.85%	94.16%	
PHASE 2 RE-INSPECTIONS AS OF MAR 09	849	795	36	18	93.64%	95.76%	944

UNCLASSIFIED//~~FOUO~~



TOTAL INSPECTION RATES

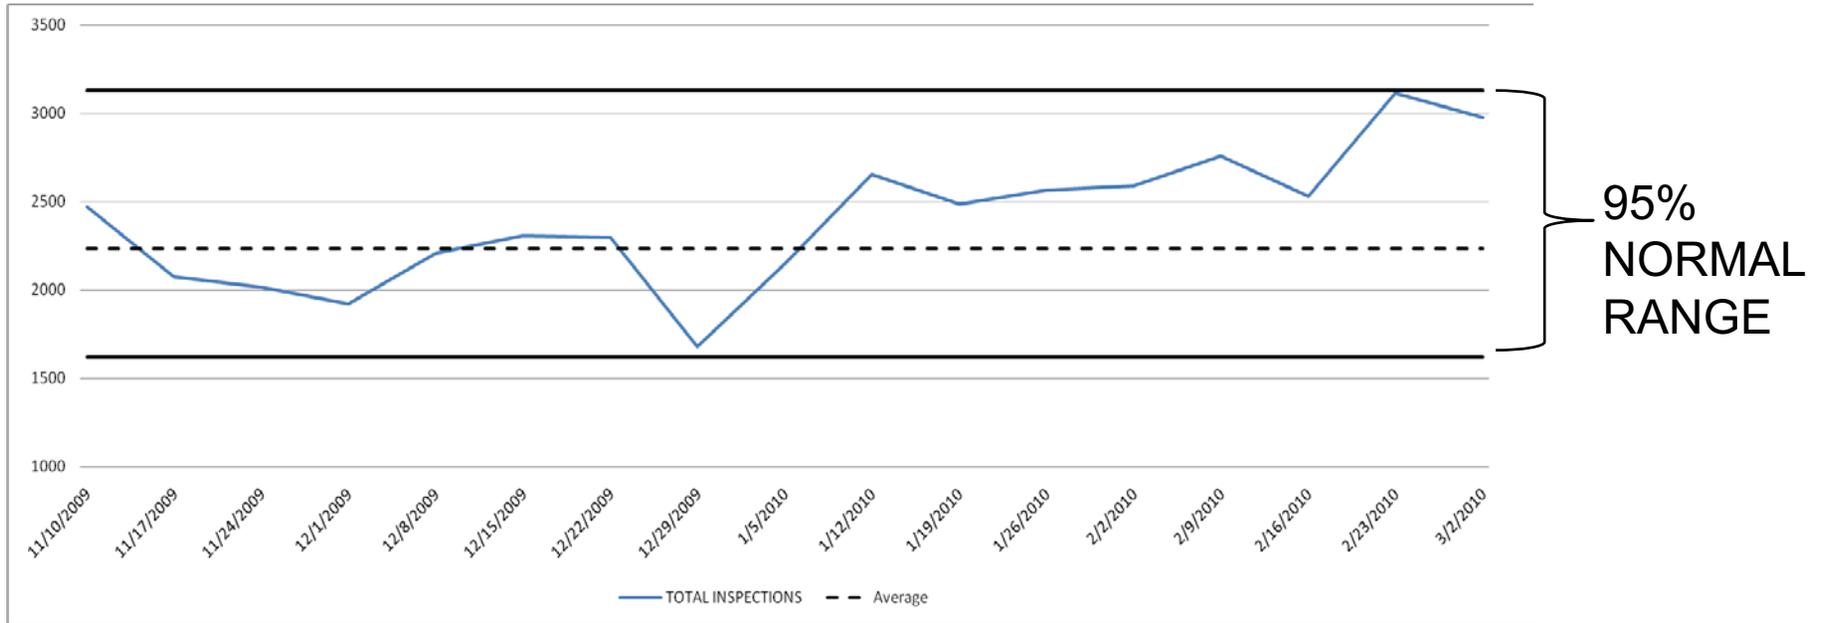


QC DATA REPORTING PERIOD (FEB 24 - MAR 02)	TOTAL	PASSED	FLASH	PRIORITY	PASS RATE	FLASH PASS RATE
PHASE 1	760	440	244	76	57.89%	67.89%
PHASE 2	2,214	1,810	88	316	81.75%	96.03%

UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

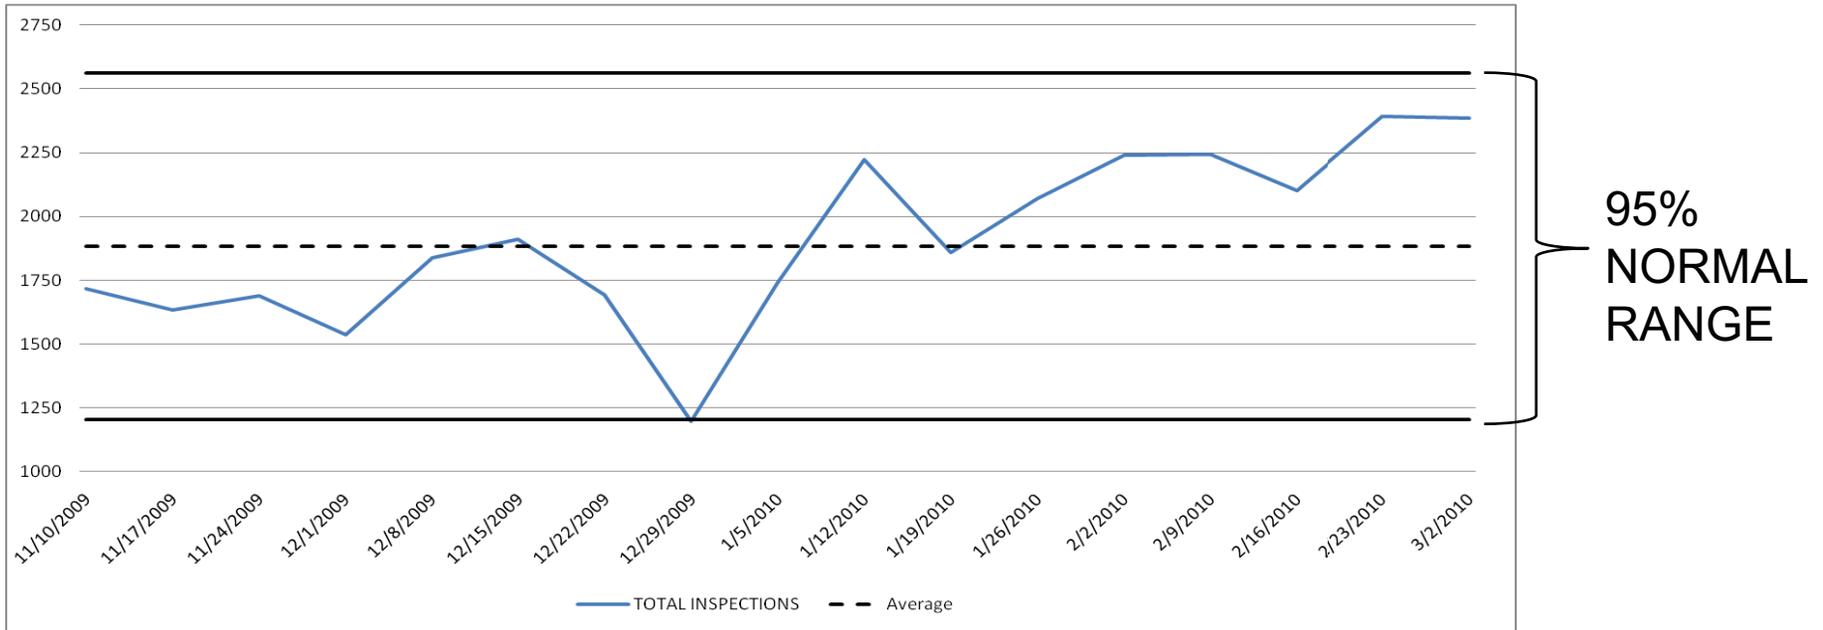

QC DATA REPORTING PERIOD (FEB 24 - MAR 02)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	423	149	224	50	35.22%	47.04%
PHASE 2	1,962	1,572	76	314	80.12%	96.13%


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

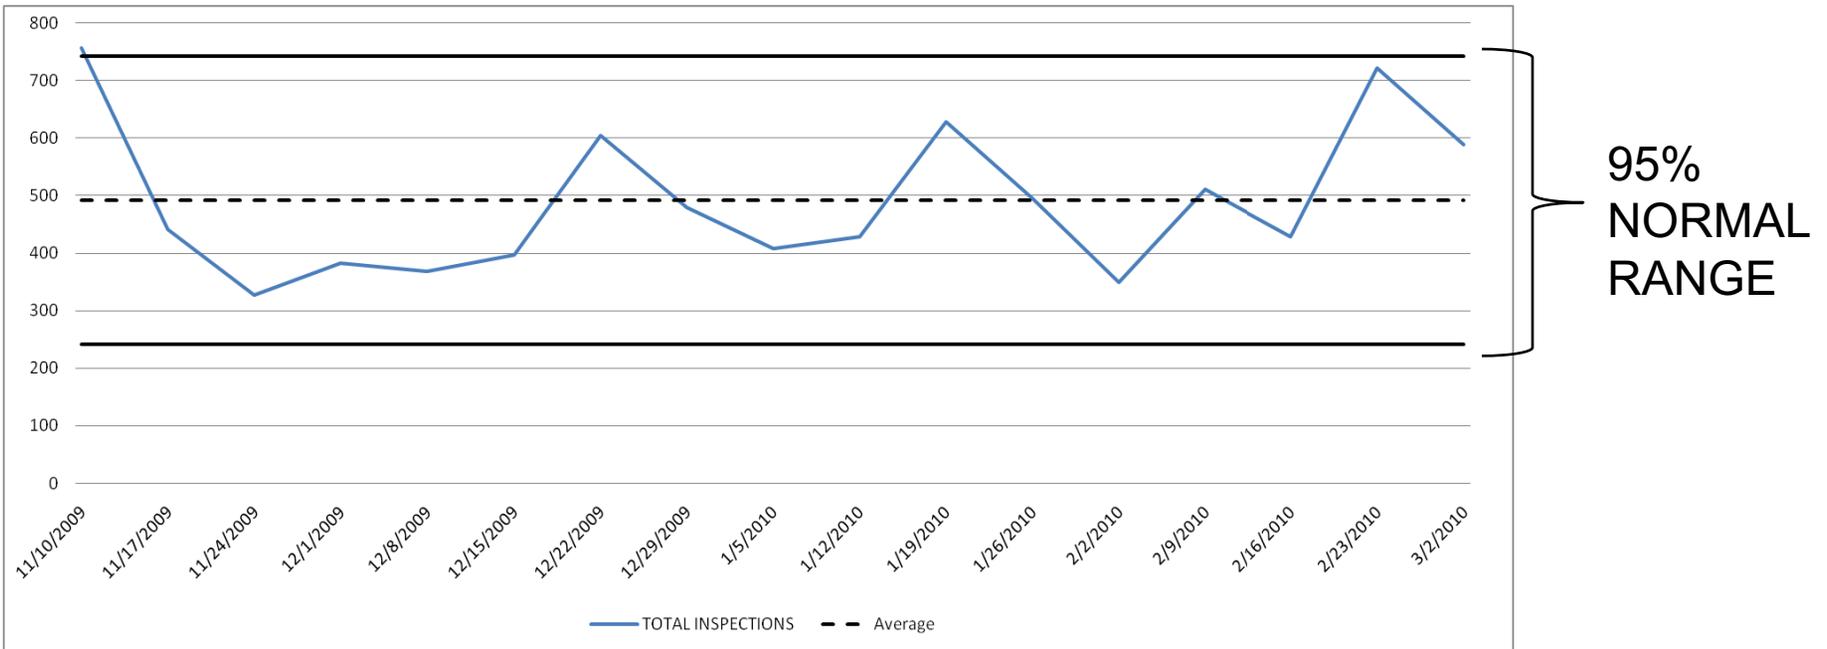


QC DATA REPORTING PERIOD (FEB 24 - MAR 02)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	337	291	20	26	86.35%	94.07%
PHASE 2	252	238	12	2	94.44%	95.24%

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

UN-MITIGATED FLASHES

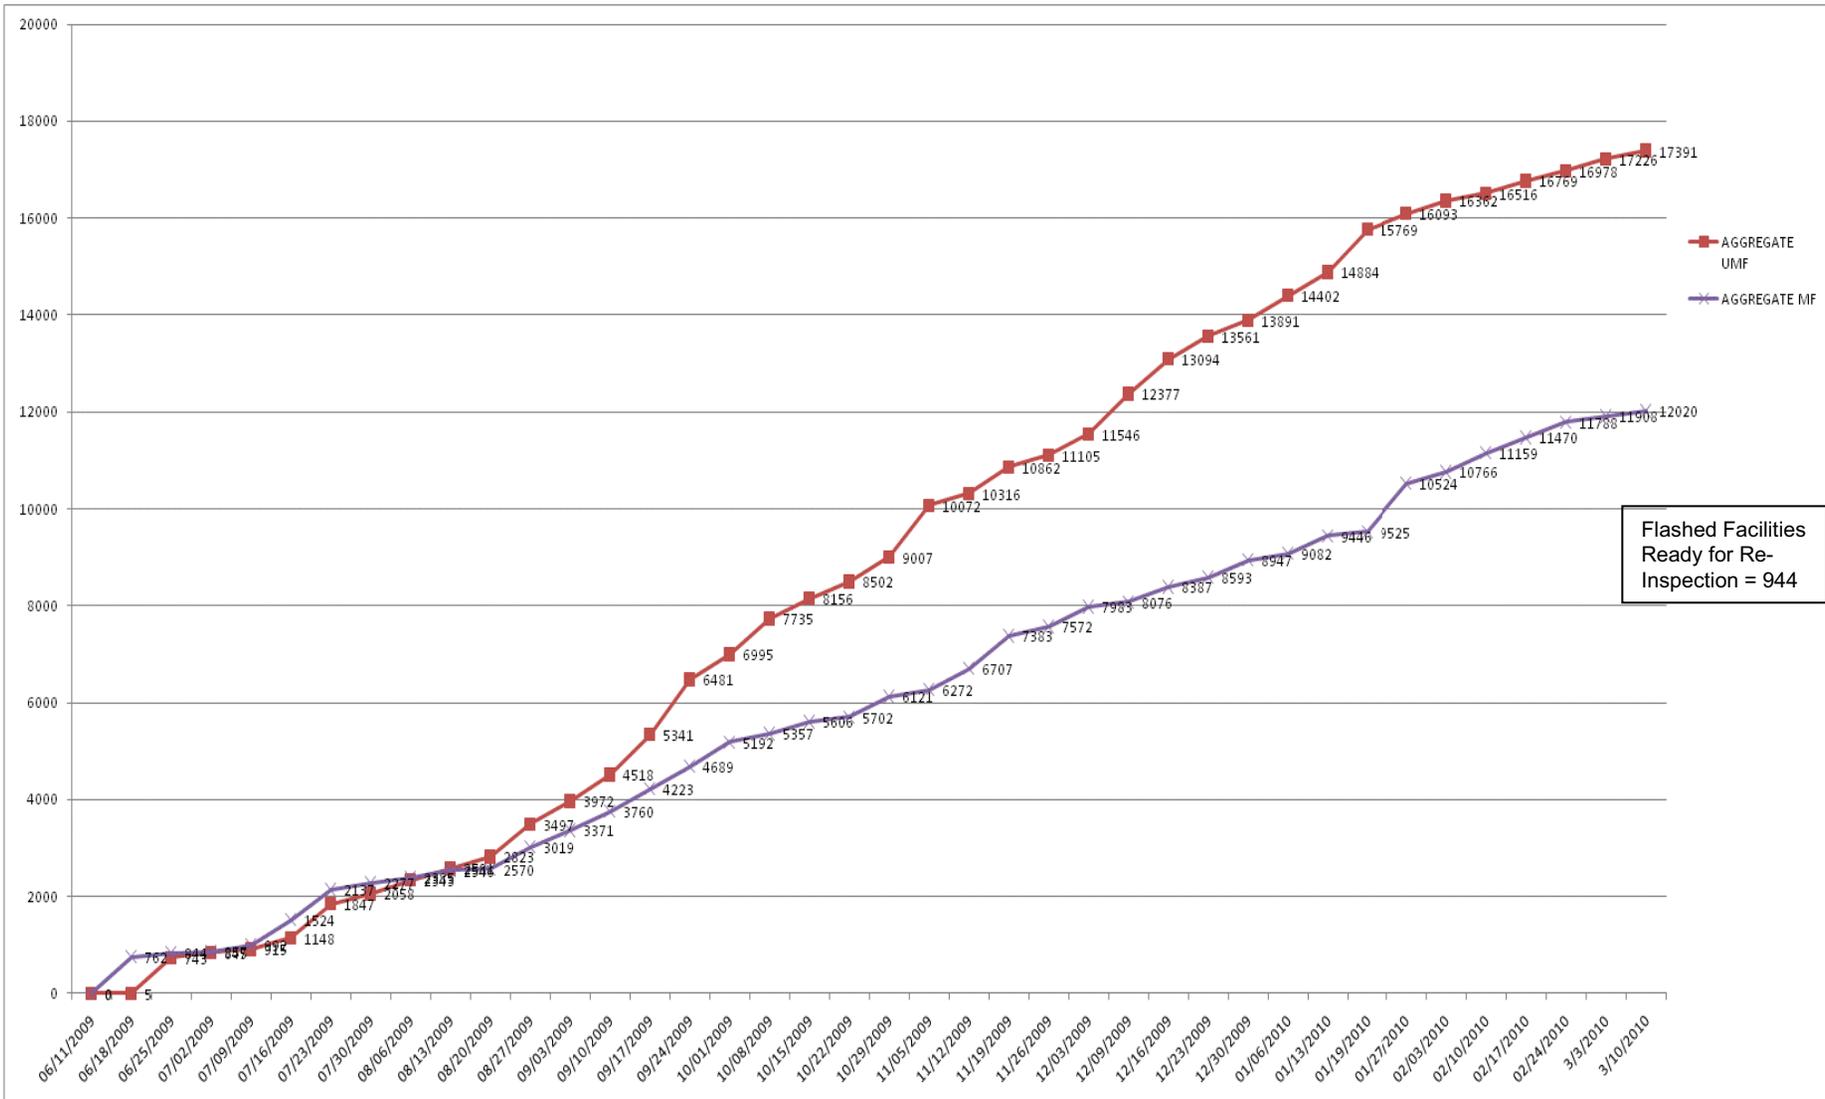

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION LHS PASS RATES

	TOP 5 FACILITY TYPES		ALL FACILITY TYPES	
	Phase 1	Phase 2	Phase 1	Phase 2
CENTER	77.96%	96.44%	75.31%	95.58%
SOUTH	83.73%	94.59%	82.45%	93.37%
NORTH	74.97%	95.74%	72.96%	93.44%

TOP 5 FACILITY TYPES
CHU
ABLUTION
GENERATOR
MDP
DP

UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments

	Total Camps	Initially Assessed by TF SAFE	SAT	UNSAT	Pass %	Re-assessed	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	103	71	33	38	46%	2	2	0	100%	8
All Others	251	181	30	151	17%	16	13	3	81%	23
Total	354	252	63	189	25%	18	15	3	83%	31

- Camps Assessed 5 Mar-11 Mar 10= 4
 - 4 UNSAT
- Camps Re-assessed 5 Mar-11 Mar 10=2
 - 2 SAT
- Camps remaining to be assessed: 71

- Camps added over last week: 3
- Camps removed: 15
 - No Longer There: 14
 - Duplicate Entry: 1



UNCLASSIFIED//~~FOUO~~



Inglett & Stubbs Progress Report

Division (# of Repair Teams)	"FLASH" Defects Repaired From SBH Inspection Reports	LHS Defects Repaired by Special Request	Facilities Assessed by Special Request	Defects Repaired This Period	Total Defects Repaired
USD-C (2)	90	14	1	6	104
USD-S (2)	6	3	0	1	9
USD-N (6)	56	0	1	15	56
TOTALS	152	17	2	22	169
USD-C	LOCATION	STATUS			
TEAM 3	IZ/Union III	Repairing LHS deficiencies at re-located LSA			
TEAM 8	R&R	Return expected 3/30/2010			
USD-S					
TEAM 7	R&R	Return expected 3/23/2010			
TEAM 9	R&R	Return expected 3/30/2010			
USD-N					
TEAM 1	JB Balad	Performing "FLASH" repairs (One Man Team)			
TEAM 2	JB Balad/R&R	One member performing "FLASH" repairs - Partner to return 3/12/2010			
TEAM 4	R&R	Return expected 3/12/2010			
TEAM 5	Balad	Just back from R&R - En route to Marez to resume "FLASH" repairs			
TEAM 6	Speicher	Performing "FLASH" repairs			
TEAM 10	R&R	Return expected 3/30/2010			

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



FIRE CHIEF'S REPORT

ORI Pass -	1 st	2 nd	3 rd
<u>Stryker</u> -	85.1% - 92.9% - 96.6%		
Fire Fighting Drills-	92.5%	87.0%	97.5%
Administrative -	81.8%	95.2%	96.2%

ORI Team is moving to Shield this week.



Structural Drill



Proficiency Drill



Proficiency Drill



Structural Drill

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 03/12
Awareness	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	USF-I PAO conduct interviews with TF SAFE Chief, Deputy Chief, Master Electrician, Fire Chief, and SGM. Rotate TF SAFE personnel to AFN Freedom Radio on Thursdays. Ongoing	USF-I Safety	
	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	USF-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets. Now running!	Submitted as Needed	USF-I Safety	
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	USF-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Safety officers, Mayor's cells and AAFES PX system- in place Country wide	Continue surveillance for compatible electrical items	USF-I Safety	

UNCLASSIFIED//~~FOUO~~