



UNCLASSIFIED//~~FOUO~~



ONE TEAM

ELECTRICAL AND FIRE SAFETY PROGRESS REPORT

23 April 2010

TASK FORCE SAFE

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



OVERVIEW


- ***Electrical Awareness Course Held***
- ***TF POWER assist visit Apr 20-27***
- ***DAIT Team Assist Visit Speicher Teams***
- ***100,000 laundry flyers distributed***
- ***USF-I PAO Filmed TF SAFE AFN Spot***

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~

WEEKLY ELECTRICAL AND FIRE INCIDENTS

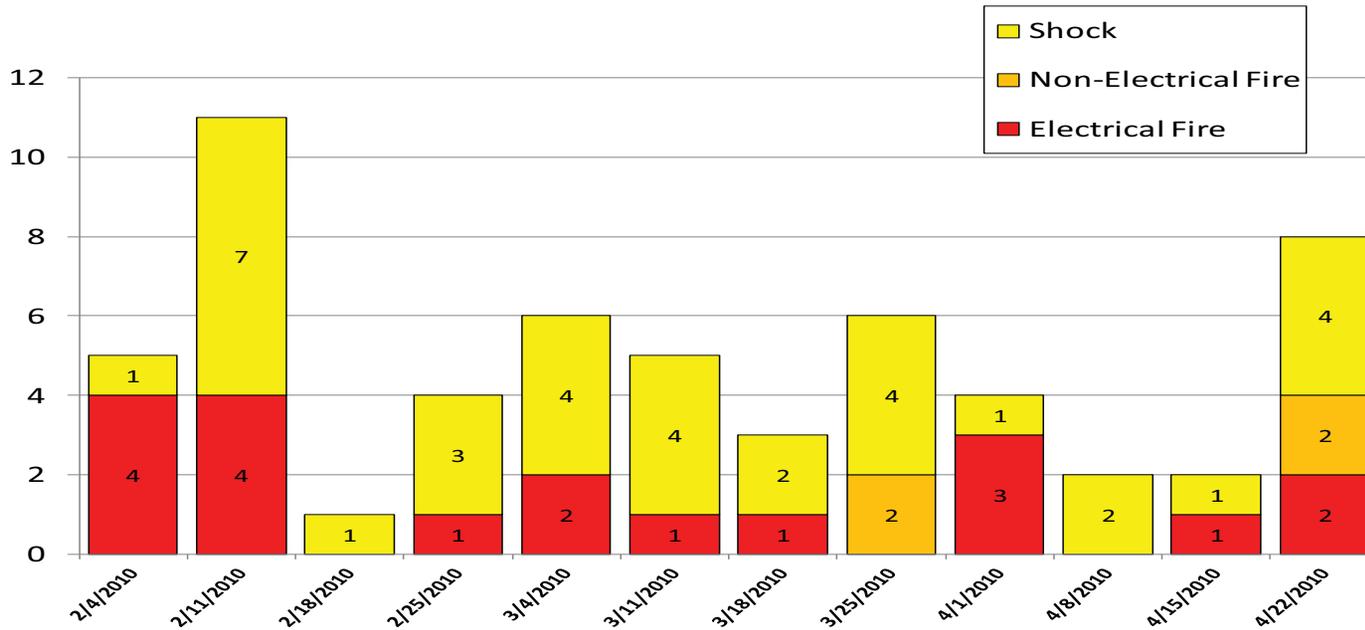

Weekly Comparison

	Week of 4/22/2010	12-Wk Avg
Electrical Fire	2 ↑	1.58
Non-Electrical Fire	2 ↑	0.33
Total Fires	4 ↑	1.92
Shock	4 ↑	2.83

Below 12-wk Average ↓
 Above 12-wk Average ↑

UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INSPECTION SUMMARY

INITIAL INSPECTIONS							
	TOTAL	PASSED	FAIL FLASH	FAIL PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 INITIAL INSPECTIONS AS OF APR 20	114,710	66,349	27,749	20,612	57.84%	75.81%	FACILITIES WITH UN-MITIGATED FLASHES
PHASE 2 INITIAL INSPECTIONS AS OF APR 20	24,769	20,434	1,386	2,949	82.50%	94.40%	2,006
REINSPECTIONS							
	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE	
PHASE 1 RE-INSPECTIONS AS OF APR 20	37,684	31,810	2,144	3,730	84.41%	94.31%	FLASHED FACILITIES READY FOR RE-INSPECTION
PHASE 2 RE-INSPECTIONS AS OF APR 20	2,198	2,065	57	76	93.95%	97.41%	558


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



TOTAL INSPECTION RATES

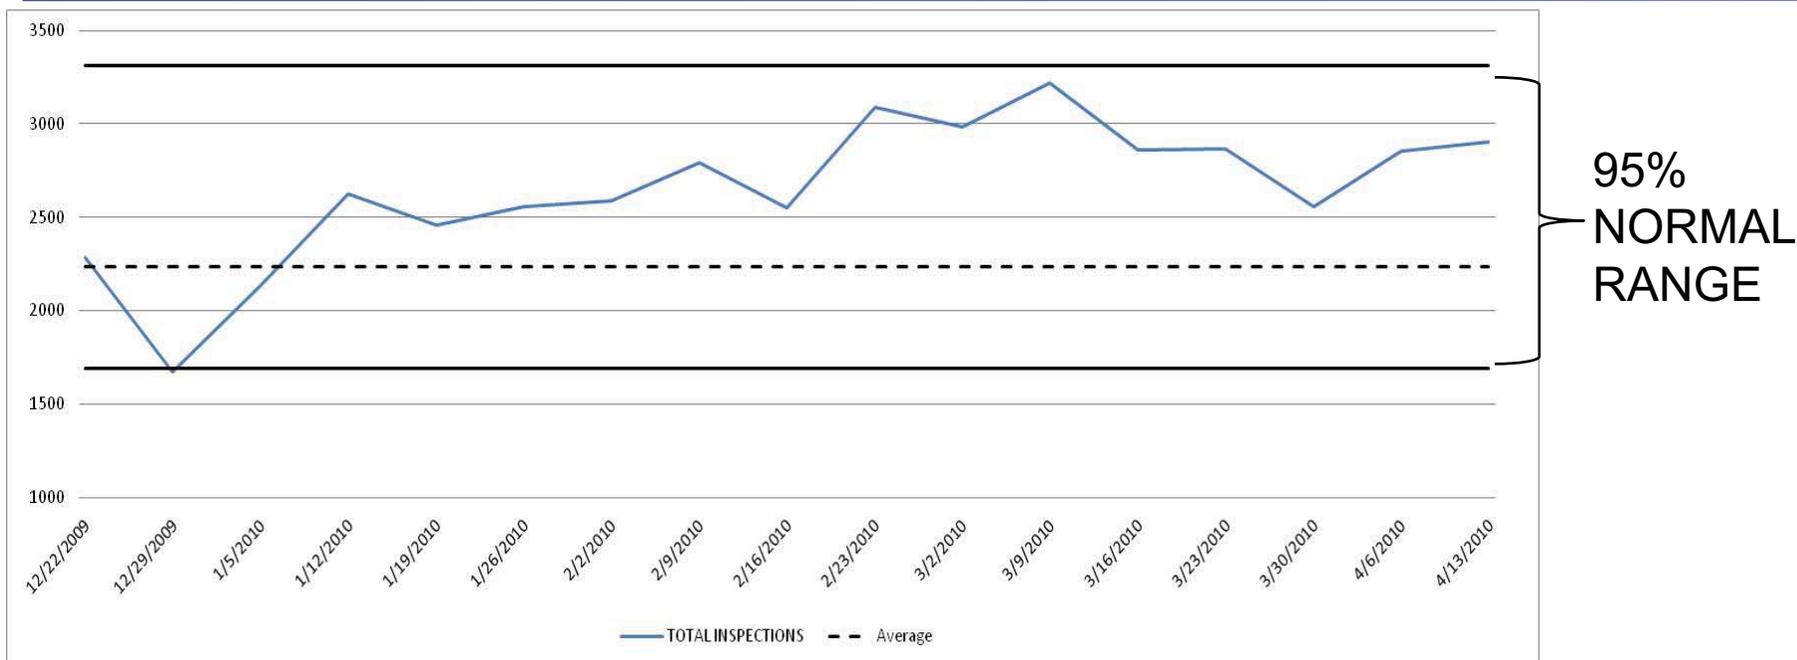

QC DATA REPORTING PERIOD (APR 07 - APR 13)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	404	319	38	47	78.96%	90.59%
PHASE 2	2,497	2,139	131	227	85.66%	94.75%


UNCLASSIFIED//~~FOUO~~



UNCLASSIFIED//~~FOUO~~



INITIAL INSPECTION RATES

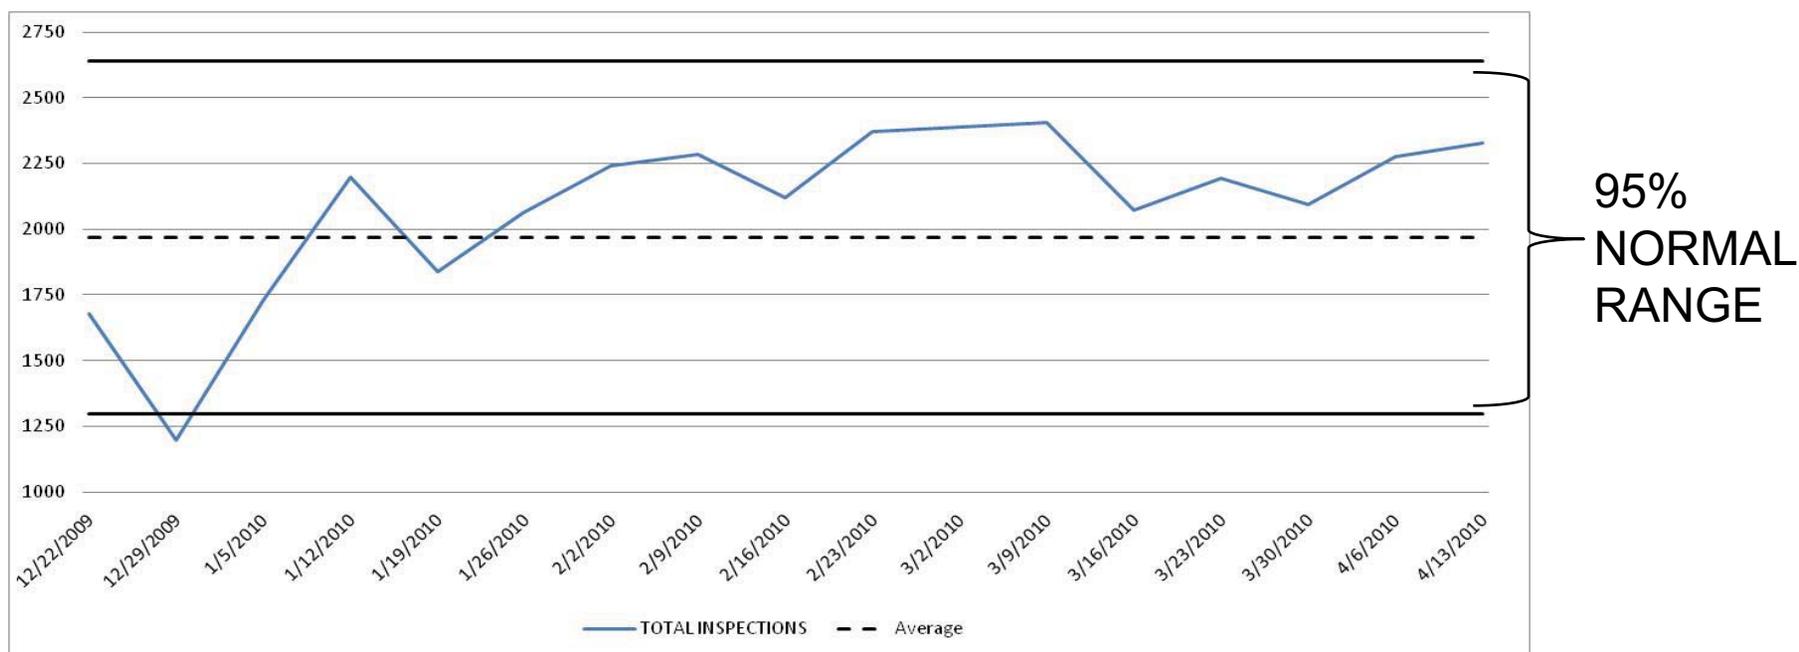


QC DATA REPORTING PERIOD (APR 07 - APR 13)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	100	53	19	28	53.00%	81.00%
PHASE 2	2,227	1,882	125	220	84.51%	94.39%

UNCLASSIFIED//~~FOUO~~



RE-INSPECTION RATES

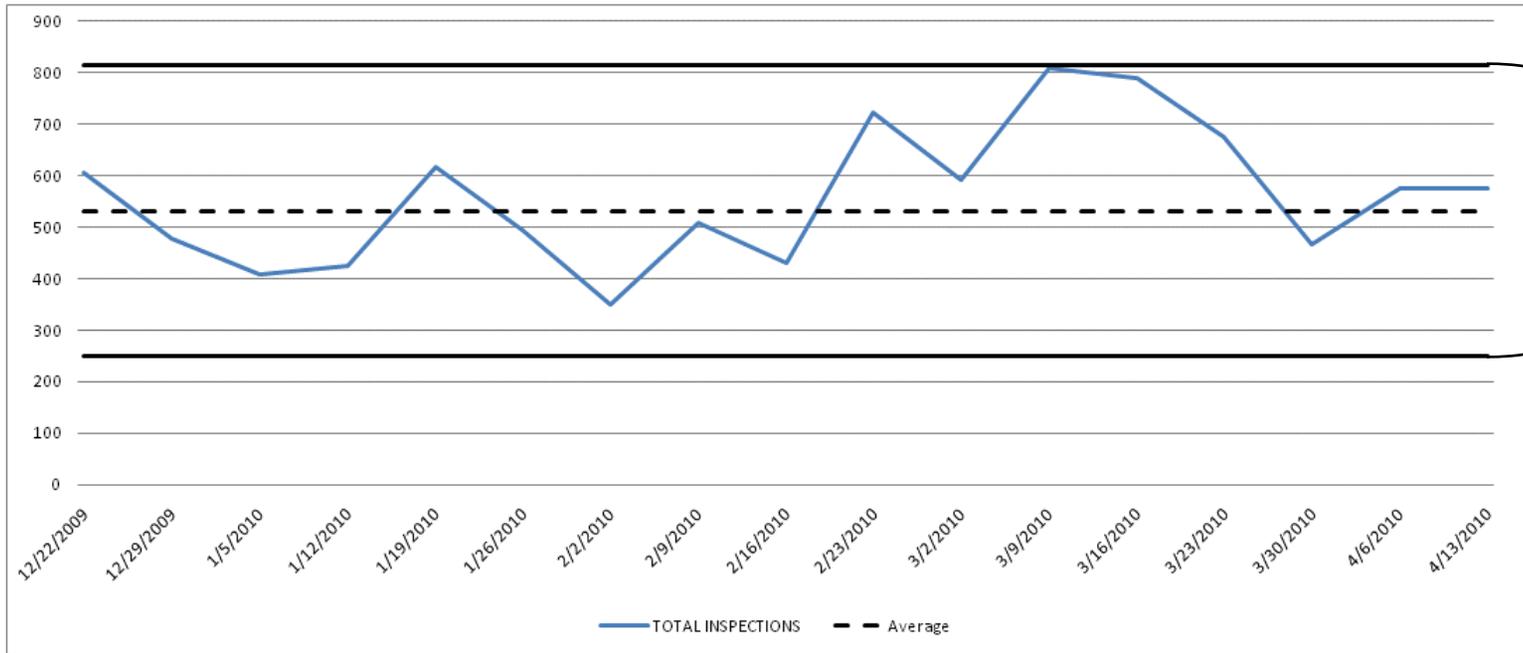


95%
NORMAL
RANGE

QC DATA REPORTING PERIOD (APR 07 - APR 13)	TOTAL	PASSED	FLASHES	FLASH TO PRIORITY	PASS RATE	LHS PASS RATE
PHASE 1	304	266	19	19	87.50%	93.75%
PHASE 2	270	257	6	7	95.19%	97.78%



UNCLASSIFIED//~~FOUO~~

UN-MITIGATED FLASHES

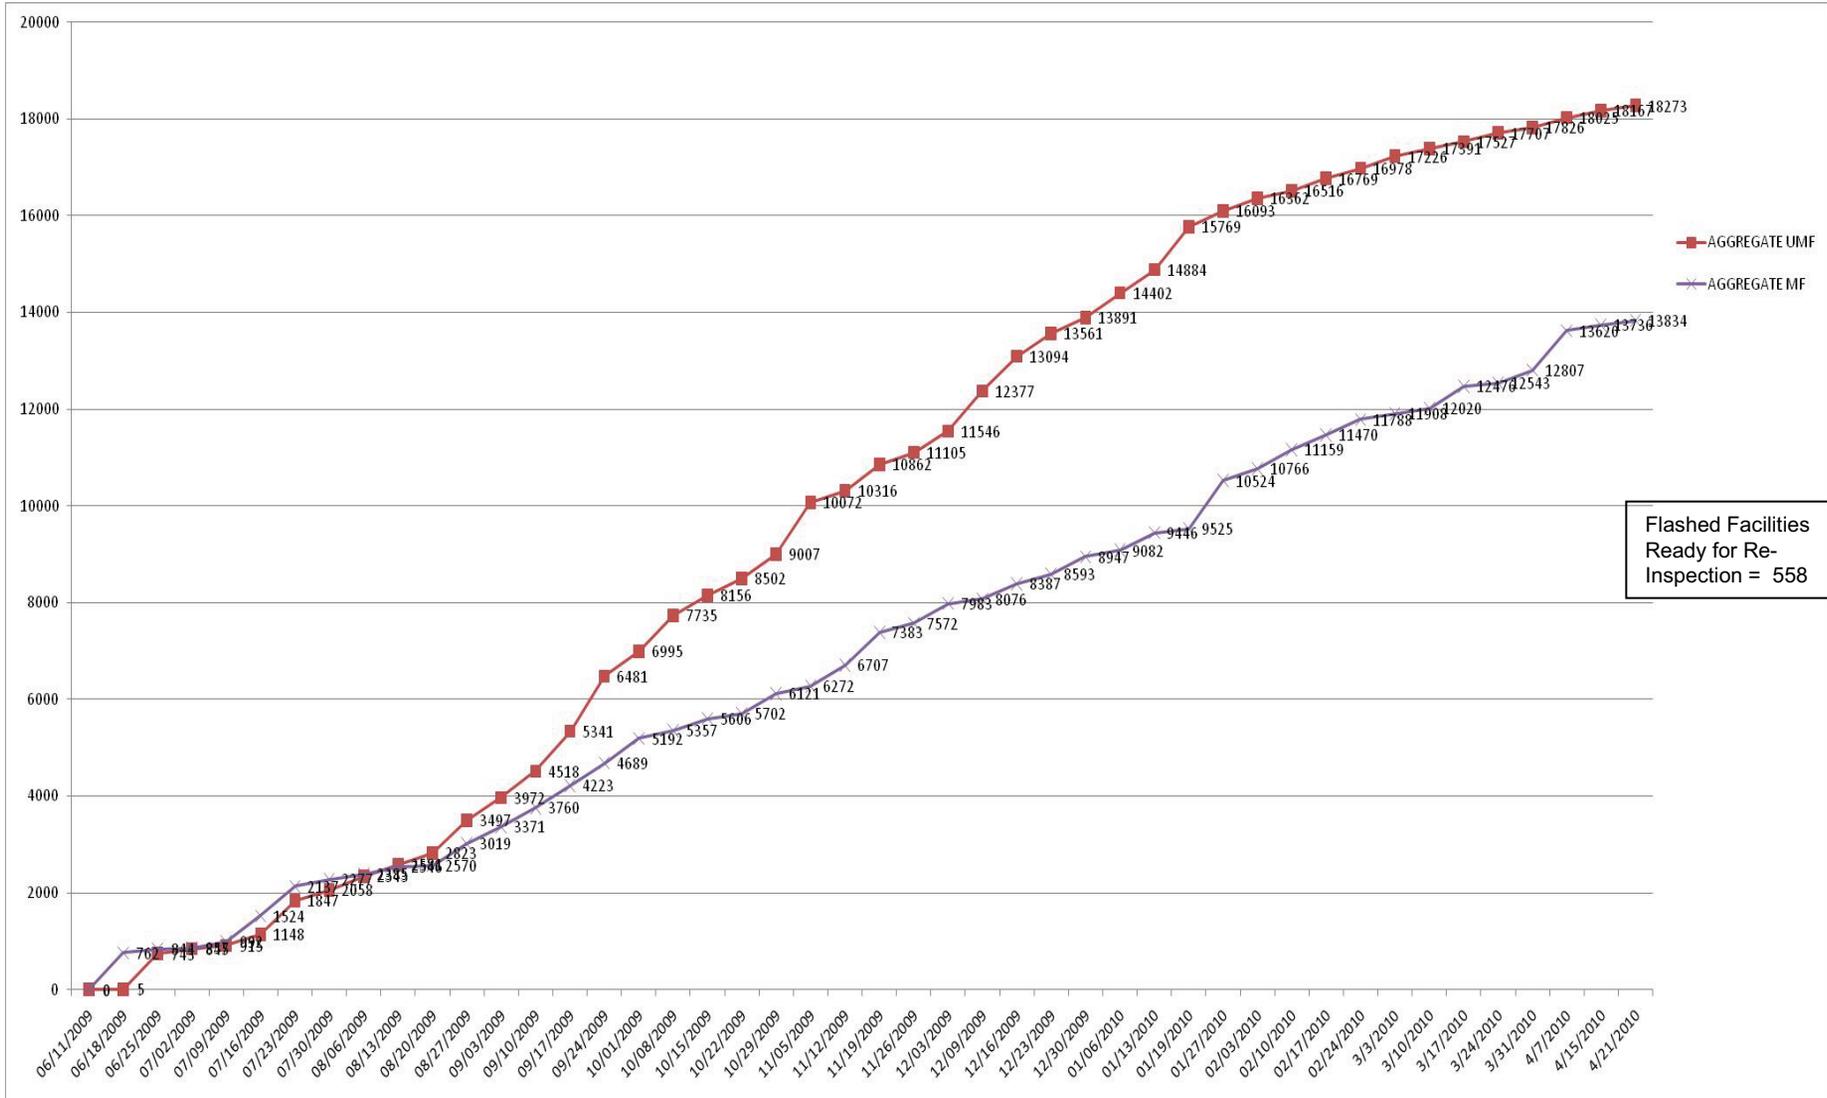

UNCLASSIFIED//~~FOUO~~



TASK FORCE SAFE

Contractor Camp Assessments

	Total Camps	Initially Assessed by TF SAFE	SAT	UNSAT	Pass %	Re-assessed	SAT	UNSAT	Pass%	Previously Inspected by TF SAFE
KBR	90	75	35	40	47%	18	17	1	94%	5
All Others	257	223	46	177	21%	72	37	35	51%	23
Total	347	298	81	217	27%	90	54	36	60%	28

- Camps Assessed APR 16-22 = 2
 - 2 SAT
- Camps Re-assessed APR 16-22 = 6
 - 2 UNSAT
 - 4 SAT
- Camps remaining to be assessed: 21
- Camps added over last week: 0
- Camps removed: 3
 - No Longer There



UNCLASSIFIED//~~FOUO~~



Inglett & Stubbs Progress Report

	"FLASH" Defects Repaired From SBH Inspection Reports	LHS Defects Repaired by Special Request (LOCATIONS)	Facilities Assessed by Special Request	Defects Repaired This Period	Total Defects Repaired
Division (# of Repair Teams)					
USD-C (3)	135	25	4	4	160
USD-S (2)	69	3	13	14	72
USD-N (5)	137	2	15	10	139
TOTALS	341	30	32	28	371
USD-C	LOCATION	STATUS			
TEAM 3	VBC	Performing "FLASH" Repairs - Extensive Project on East Liberty			
TEAM 6	VBC				
TEAM 8	VBC				
USD-S					
TEAM 1	Tallil	Performing LHS Repairs Awaiting Movement to Kalsu			
TEAM 7	Tallil				
USD-N					
TEAM 2	JB Balad	Performing "FLASH" Repairs			
TEAM 4	Marez	Performing LHS Repairs at DIBs CCPs (2 of 13 Complete) Awaiting Return of Trailers from Sykes & Movement to next DIB site			
TEAM 5	Marez				
TEAM 9	JB Balad	Performing "FLASH" Repairs			
TEAM 10	Speicher	Performing "FLASH" Repairs			

UNCLASSIFIED//~~FOUO~~



FIRE CHIEF'S REPORT

ORI - BASRAH - 95.7%

Fire Fighting Drills- 97.5%

Administrative - 94.2%

This is the first look at Salleyport Fire Department which is a JCC-I Contract.



Structural Drill



ARFF Egress Drill



Structural Drill



UNCLASSIFIED//~~FOUO~~



TF SAFE AWARENESS

Complete
 In Progress
 Not Started

Key Tasks	Sub Tasks	Remarks	Way Ahead	Responsible Unit/Action Officer	Status as of 04/23
Awareness	Command Information	Issue Safety Alerts as necessary • AFN Radio campaign in Progress. On Air programs scheduled and executed • Safety Alerts for Flashes and Fires	<i>USF-I PAO conducted PSA session / interview with TF SAFE's SFC (b)(3), (b)(6) on 20 Apr 2010. More to come with another PSA.</i>	USF-I Safety	XXXX
	Electrical Safety Video	Revised by CRC at Ft. Rucker, AL and disseminated to MND's and Corps Separates • Partial play at Theater Portal	ARCENT and CENTCOM approved to be presented or available for Soldiers and civilians prior to entering Theater.	USF-I Safety	
	Computer Screensavers	Electrical and Fire safety messages for NIPR and SIPR nets. Now running!	<i>Sent several to TF Safe Safety for vetting.</i>	USF-I Safety	XXXX
	Regenerate Poster Supply. Develop new posters. Contact Safety chain to spur PAO involvement	Contact Safety chain to spur Local PAO activities in support of TF-SAFE	Distribute Flyers and Posters to Safety personnel and Mayors Cell	USF-I Safety	
	Electrical Safety at Point of Purchase	Coordinating with Safety officers, Mayor's cells and AAFES PX system- in place Country wide	Continue surveillance for compatible electrical items.	USF-I Safety	

UNCLASSIFIED//~~FOUO~~